


PRICE YARD WAREHOUSE RESTROOM REMODEL

MANTI-LA SAL NATIONAL FOREST

PRICE, UT

LIST OF DRAWINGS

| SHT. | DWG. | SHEET TITLE |
|----------------|-------|------------------------------|
| <u>GENERAL</u> | | |
| 1 | G1 | COVER SHEET, LOCATION |
| 2 | GA1 | ACCESSIBLE REQUIREMENTS |
| 3 | GA2 | ACCESSIBLE REQUIREMENTS |
| 4 | D1.01 | DEMOLITION PLANS |
| 5 | A1.01 | PLAN AND INTERIOR ELEVATIONS |
| 6 | P1.01 | PLUMBING SCHEDULE, DETAIL |
| 7 | E1 | ELECTRICAL |

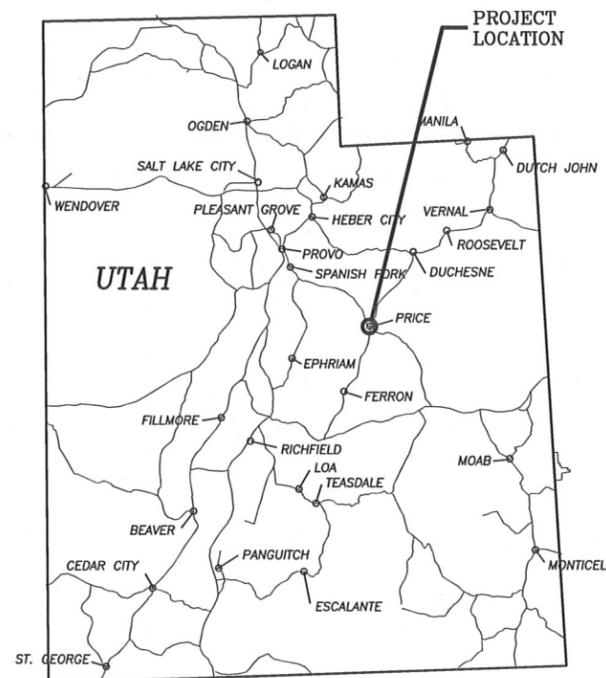


PRICE, UTAH


| | |
|--------------------------|-----------------|
| <i>APPROVED</i> | |
| <i>Forrest A. Pateco</i> | <i>8 FEB 16</i> |
| FOREST SUPERVISOR | DATE |
| <i>Cathy Christensen</i> | <i>2/2/2016</i> |
| FOREST ENGINEER | DATE |

TOILET COMPARTMENT CLEARANCES : LAVATORY & ACCESSORY CLEARANCES


general clearance guidance only, see plans for specific fixtures and configurations.

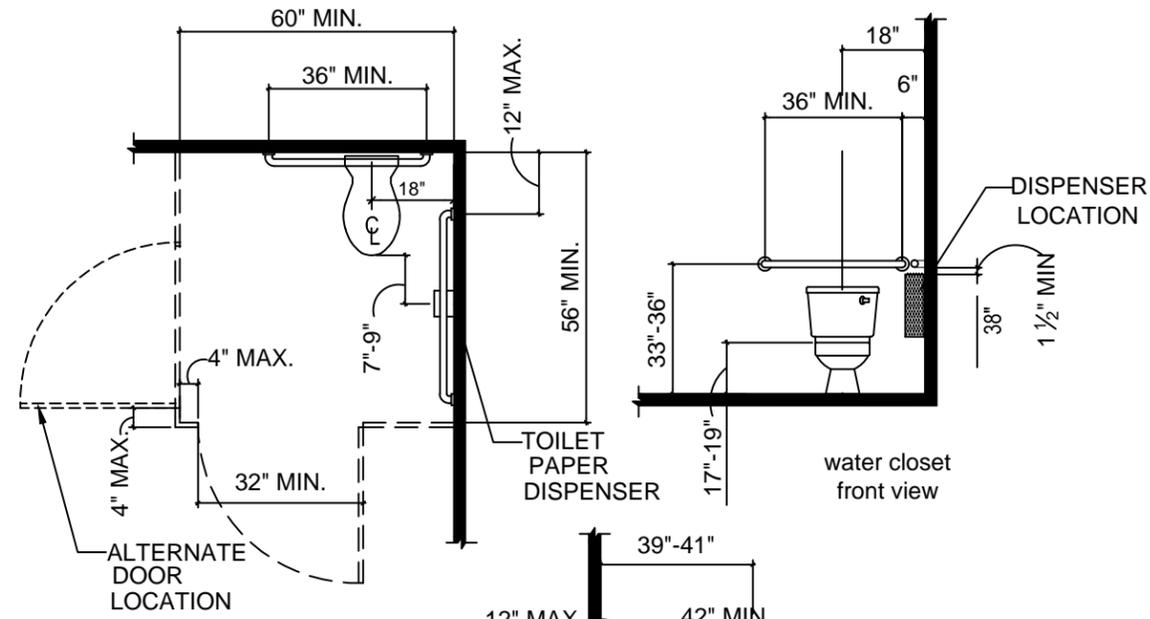


ALTERNATE DOOR LOCATION
wheel chair accessible toilet stall plan view



(a) accessible water closets

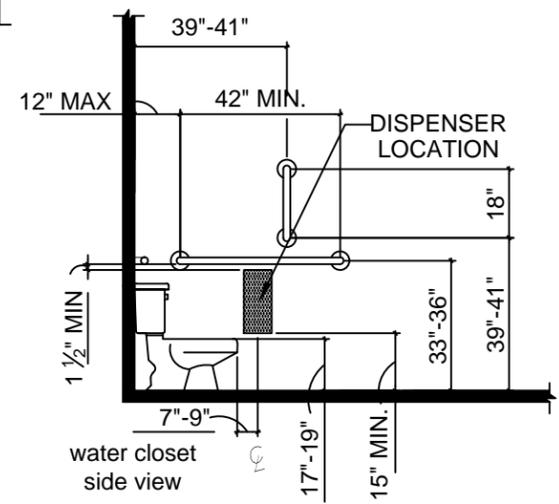


ACCESSIBLE TOILET COMPARTMENTS CLEARANCES AND MOUNTING HEIGHTS

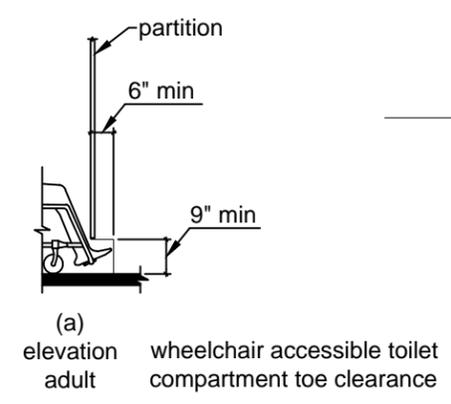


(a) elevation adult wheelchair accessible toilet compartment toe clearance


LEVEL CHANGE:

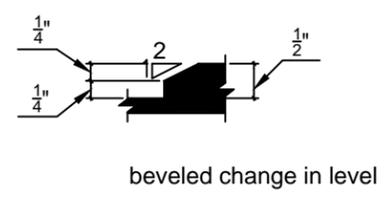



beveled change in level

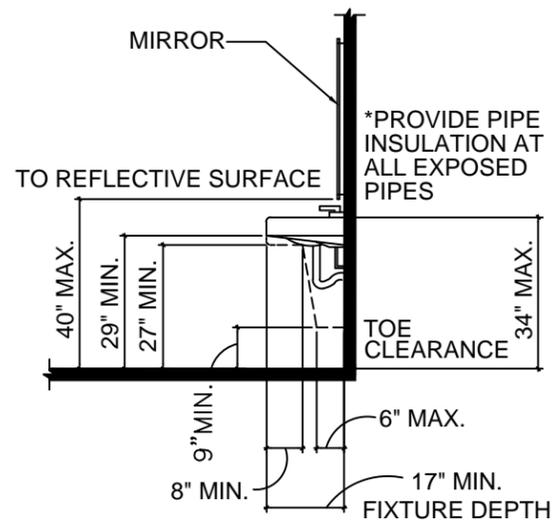

LAVATORY SIDE VIEW

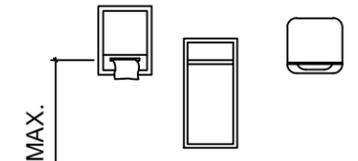


CONTROLS & OPERATING MECHANISMS

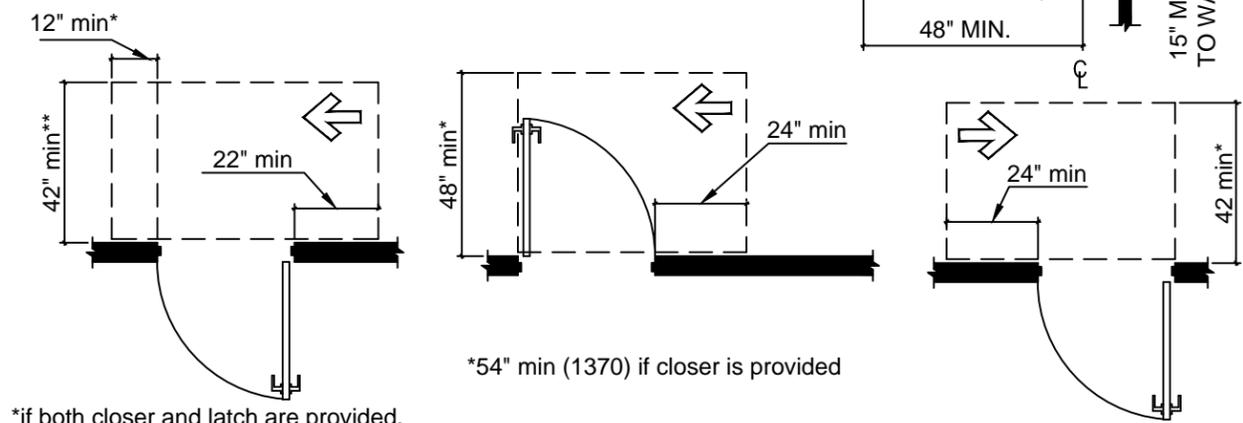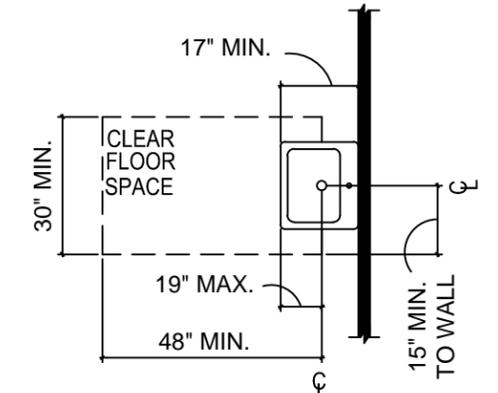


*if both closer and latch are provided.
**48 inch min if both closer and latch provided.

(a) hinge approach, push side (b) latch approach, pull side (c) latch approach, push side

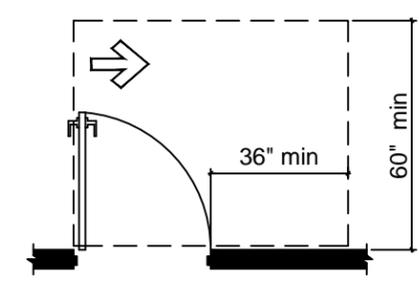

(d) hinge approach, pull side

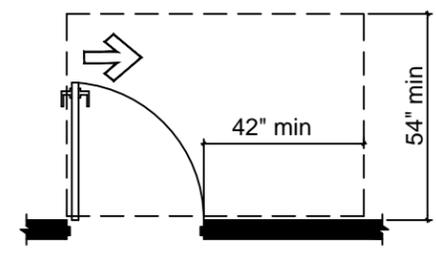

(e) hinge approach, pull side

maneuvering clearances at manual swinging doors



| | | |
|----------|------------------|-----------------------|
| BY: SMHW | CHECK: D JEPPSEN | DATE |
| DESIGN | DRAWING | APPROVED |
| BY: SMHW | CHECK: D JEPPSEN | DIRECTOR, ENGINEERING |

PRICE YARD WAREHOUSE RESTROOM REMODEL
ACCESSIBLE REQUIREMENTS


SIGNS / PICTOGRAMS:




INTERNATIONAL ACCESSIBILITY SYMBOL




RAISED



PROPORTIONS

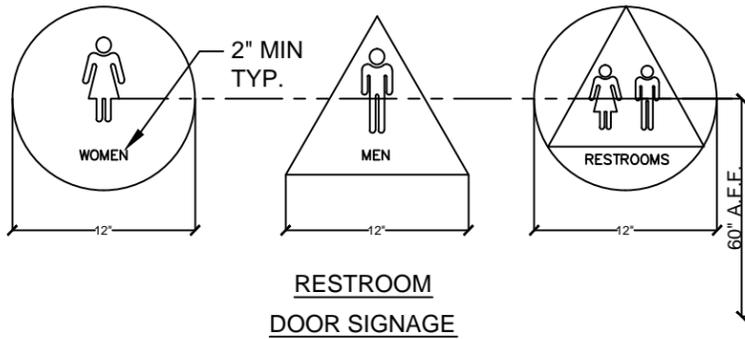

WALL MOUNTED SIGNAGE TO BE LOCATED ON LATCH SIDE OF DOOR CLEAR OF DOOR-SWING. MOUNT AT 60" TO CENTERLINE OF SIGN FROM FLOOR

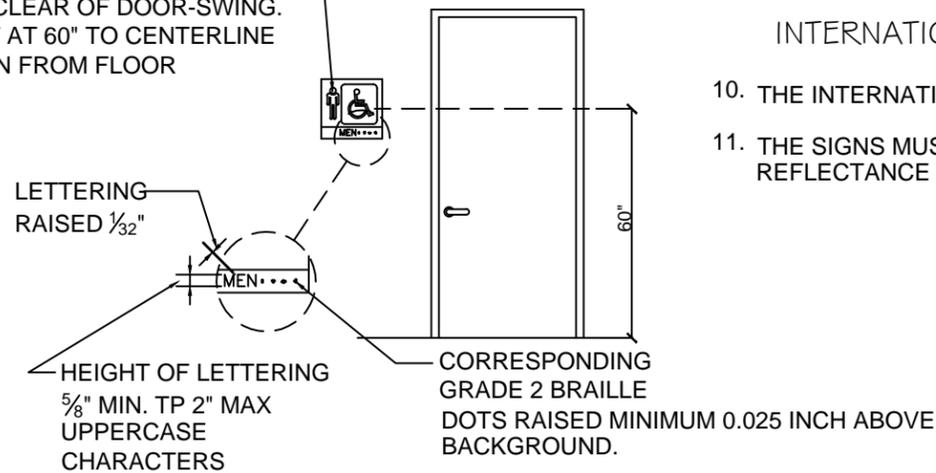

LETTERS AND NUMBERS:


- LETTERS AND NUMBERS ON SIGNS SHALL BE RAISED 1/32" MINIMUM AND SHALL BE SANS-SERIF UPPERCASE CHARACTERS ACCOMPANIED BY GRADE 2 BRAILLE. (2004 ADAABAG, CHAPTER 7)
- RAISED CHARACTERS OR SYMBOLS SHALL BE A MINIMUM OF 5/8" HIGH. (2004 ADAABAG CHAPTER 7)
- PICTORIAL SYMBOL SIGNS (PICTOGRAMS) SHALL BE ACCOMPANIED BY THE EQUIVALENT VERBAL DESCRIPTION PLACED DIRECTLY BELOW THE PICTOGRAM. THE BORDER DIMENSION OF THE PICTOGRAM SHALL BE A MINIMUM OF 6" IN HEIGHT. (2004 ADAABAG CHAPTER 7)
- LETTERS AND NUMBERS ON SIGNS SHALL HAVE A WIDTH-TO-HEIGHT RATIO OF BETWEEN 3:5 AND 1:1 AND A STROKE WIDTH-TO-HEIGHT RATIO BETWEEN 1:5 AND 1:10. (2004 ADAABAG CHAPTER 7)
- CHARACTERS AND SYMBOLS SHALL CONTRAST WITH THEIR BACKGROUND, EITHER LIGHT CHARACTERS ON A DARK BACKGROUND OR DARK CHARACTERS ON A LIGHT BACKGROUND. (2004 ADAABAG CHAPTER 7)
- CHARACTERS AND NUMBERS ON SIGNS SHALL BE SIZED ACCORDING TO THE VIEWING DISTANCE FROM WHICH THEY ARE TO BE READ. THE MINIMUM HEIGHT IS MEASURED USING AN UPPER CASE X. LOWER CASE CHARACTERS ARE PERMITTED. FOR SIGNS SUSPENDED OR PROJECTED ABOVE THE FINISH FLOOR IN COMPLIANCE WITH SECTION 1121B, THE MINIMUM CHARACTER HEIGHT SHALL BE 3". (2004 ADAABAG CHAPTER 7)
- CONTRASTED GRADE 2 BRAILLE SHALL BE USED WHEREVER BRAILLE SYMBOLS ARE SPECIFICALLY REQUIRED IN OTHER PORTIONS OF THESE REGULATIONS. DOTS SHALL BE 1/10" ON CENTERS IN EACH CELL WITH 2/10" SPACE BETWEEN CELLS. DOTS SHALL BE RAISED A MINIMUM OF 1/40" ABOVE THE BACKGROUND. (2004 ADAABAG, CHAPTER 7)

SIGN LOCATIONS:


- ALL BUILDING ENTRANCES THAT ARE ACCESSIBLE TO AND USABLE BY PERSONS WITH DISABILITIES AND AT EVERY MAJOR JUNCTION ALONG OR LEADING TO AN ACCESSIBLE ROUTE OF TRAVEL SHALL BE IDENTIFIED WITH A SIGN DISPLAYING THE INTERNATIONAL SYMBOL OF ACCESSIBILITY AND WITH ADDITIONAL DIRECTIONAL SIGNS, AS REQUIRED, TO BE VISIBLE TO PERSONS ALONG APPROACHING PEDESTRIAN WAYS. (2004 ADAABAG, CHAPTER 7)
- WHEN PERMANENT IDENTIFICATION IS PROVIDED FOR ROOMS AND SPACES, RAISED LETTERS SHALL BE PROVIDED AND SHALL BE ACCOMPANIED BY BRAILLE IN CONFORMANCE WITH ANSI SECTION 1117B.5.6. SIGNS SHALL BE INSTALLED ON THE WALL ADJACENT TO THE LATCH OUTSIDE OF THE DOOR. WHERE THERE IS NO WALL SPACE ON THE LATCH SIDE, INCLUDING AT LEAF DOORS, SIGNS SHALL BE PLACE ON THE NEAREST ADJACENT WALL, PREFERABLY ON THE RIGHT. MOUNTING HEIGHT SHALL BE 60" ABOVE THE FINISH FLOOR TO THE CENTERLINE OF THE SIGN. MOUNTING LOCATION SHALL BE DETERMINED SO THAT THE PERSON MAY APPROACH WITHIN 3" OF THE SIGNAGE WITHOUT ENCOUNTERING PROTRUDING OBJECTS OR STANDING WITHIN THE SWING OF A DOOR. (2004 ADAABAG, CHAPTER 7)

INTERNATIONAL SYMBOL OF ACCESSIBILITY:

- THE INTERNATIONAL SYMBOLS OF ACCESSIBILITY ARE THE STANDARD CONFIGURATIONS USED TO IDENTIFY ACCESSIBLE FACILITIES.
- THE SIGNS MUST BE FABRICATED FROM NON-GLARE FINISH. SIGN TEXT AND BACKGROUND MUST CONTRAST A MINIMUM OF 70% IN LIGHT REFLECTANCE VALUE PER ADAABAG 703.7.1.

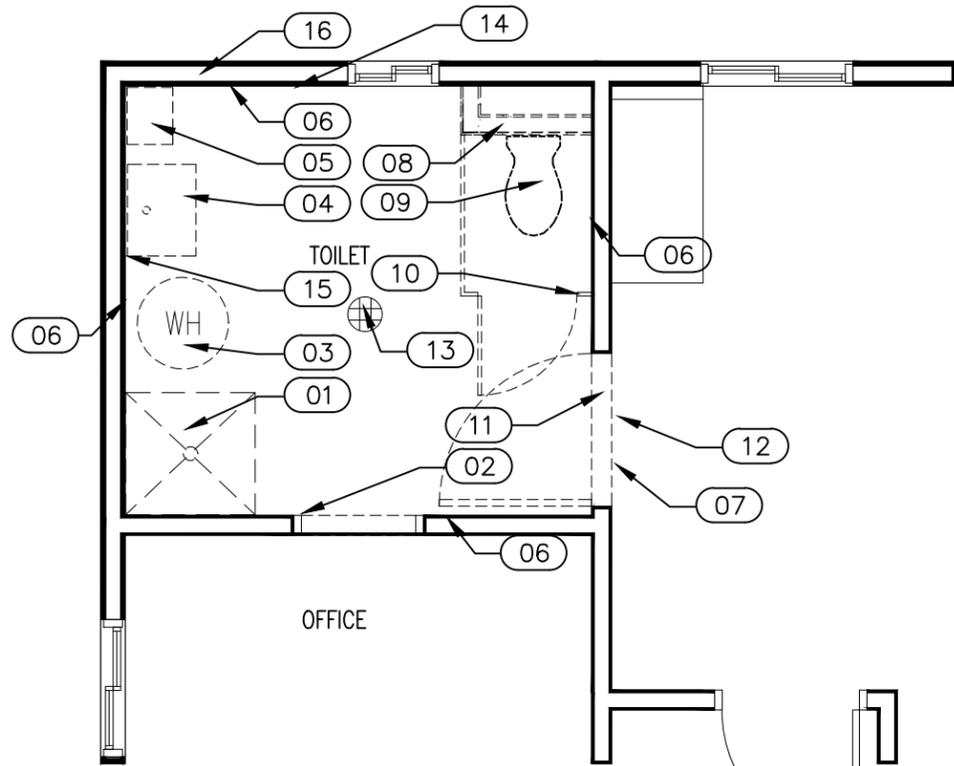

1 DEMOLITION PLAN
SCALE: 1/4" = 1'-0"

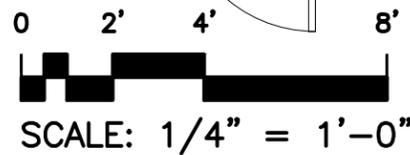

KEYED NOTES


- 01 REMOVE AND DISPOSE OF FIBERGLASS SHOWER UNIT. REMOVE PLUMBING BACK TO SERVICE ENTRY AND WATER HEATER.
- 02 PREP OPENING FOR FINISH WORK.
- 03 REMOVE AND DISPOSE OF WATER HEATER AND COLD WATER SERVICE ENTRY. COORDINATE SHUT DOWN AND REMOVAL OF TOILET WITH OCCUPANTS.
- 04 REMOVE AND DISPOSE OF SERVICE SINK, FAUCET AND PLUMBING.
- 05 REMOVE AND DISPOSE OF WOOD CABINETRY, MIRRORS, TOWEL DISPENSERS, DRINK CUP HOLDER, SOAP DISPENSERS AND HOLDERS, TOILET ACCESSORIES ETC.
- 06 REMOVE AND DISPOSE OF ALL WOOD SLAT CEILING COVERING, WALL FIBERBOARD, DRYWALL AND TRIM.
- 07 EXISTING DOOR NOT TO BE REMOVED
- 08 REMOVE FURRED OUT WALL AREA AND PREP TO ENCLOSE PLUMBING IN WALLS.
- 09 REMOVE AND DISPOSE OF TOILET AND PLUMBING BACK TO ENTRY.
- 10 REMOVE AND DISPOSE OF WOOD TOILET PARTITION, TOILET PAPER DISP.
- 11 REMOVE WALL COVERING TO INSTALL PLUMBING FOR NEW SINK.
- 12 EXISTING SURFACE MOUNTED CONDUIT/ ELECTRICAL AROUND DOOR, NOT PART OF CONTRACT AND NOT TO BE REMOVED.
- 13 REMOVE FLOOR DRAIN GRATE FOR REPLACEMENT. WASH FLOORING WITH PHOSPHORIC ACID TO PREPARE FOR FLOORING INSTALLATION. PATCH ANY CONCRETE AS NEEDED FOR DRAINAGE PIPING.
- 14 REMOVE AND DISPOSE OF STUB OUT FOR MISSING SINK.
- 15 REMOVE AND DISPOSE OF ALL SURFACE MOUNTED ELECTRICAL CONDUIT, WIRE, OUTLETS, LIGHTS, SWITCHES, ETC AND PREP FOR NEW.
- 16 REMOVE AND DISPOSE OF ANY WALL INSULATION AND PREP FOR NEW.



| | | | |
|-------------------|-------------------|-----------------------|-------|
| BY: SMHW | BY: SMHW | APPROVED: | DATE: |
| CHECK: D JEPPESEN | CHECK: D JEPPESEN | DIRECTOR, ENGINEERING | |
| DESIGN | DRAWING | | |



**PRICE YARD WAREHOUSE
RESTROOM REMODEL**

DEMOLITION PLANS

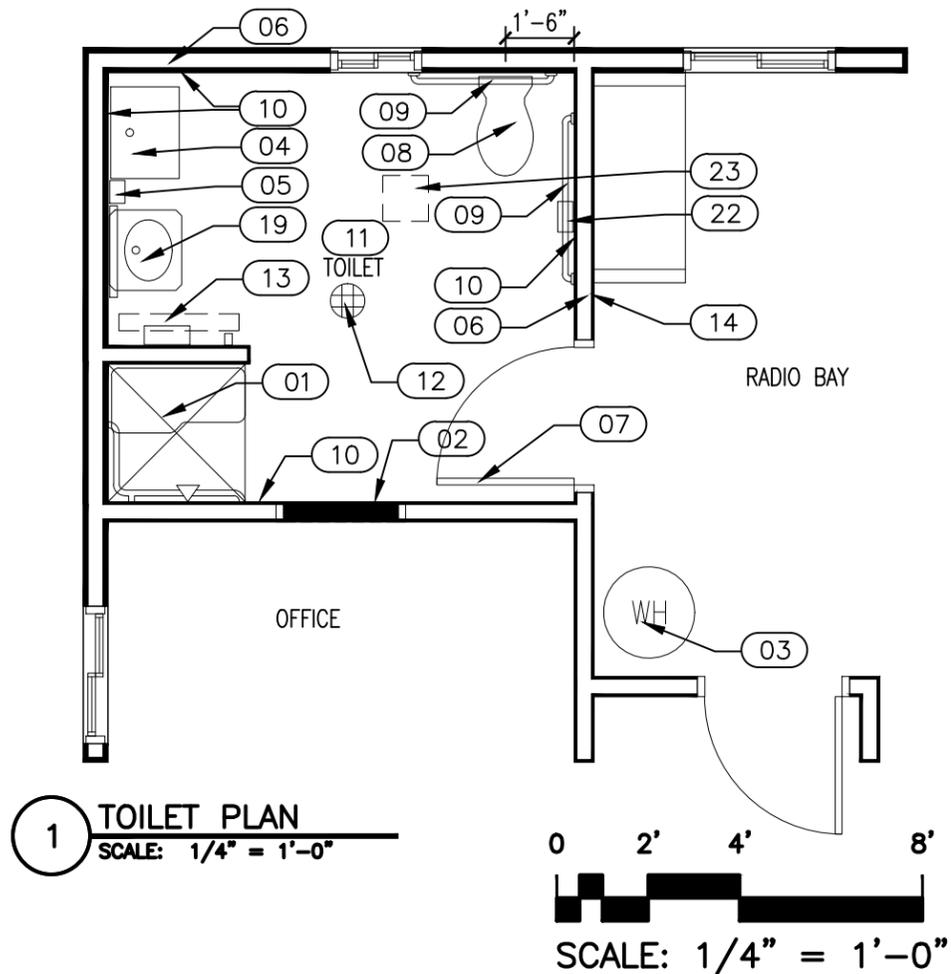

- KEYED NOTES**
- (01) PROVIDE AND INSTALL 4 PIECE FIBERGLASS SHOWER UNIT WITH FOLDING SEAT, GRAB BARS. SEE PLUMBING SCHEDULE. PROVIDE ADDITIONAL FRAMING. INSTALL GLASS MAT BEHIND UNIT.
 - (02) PROVIDE AND INSTALL DRYWALL, TAPED, SANDED PAINT ENTIRE WALL.
 - (03) PROVIDE AND INSTALL NEW 50 GALLON ELECTRIC WATER HEATER. SEE PLUMBING SCHEDULE. PROVIDE ELECTRICAL SERVICE DISCONNECT.
 - (04) PLUMB, PROVIDE AND INSTALL NEW SERVICE SINK, FAUCET AND PLUMBING. SEE PLUMBING SCHEDULE.
 - (05) PROVIDE AND INSTALL MIRROR, TOWEL DISPENSER, SOAP DISPENSER, TOWEL HOOKS, DRAIN GUARD, ETC. SEE TOILET ACCESSORY SCHEDULE AND INTERIOR ELEVATIONS.
 - (06) INSTALL 6" FIBERGLASS INSULATION IN ALL WALLS AND CEILING. PROVIDE AND INSTALL 5/8" THICK WATER RESISTANT DRYWALL, TAPED, SANDED, FINISHED, PAINTED.
 - (07) PAINT METAL DOOR AND FRAME, 20 MINUTE RATED
 - (08) PROVIDE AND INSTALL TOILET, SUPPLY, REPAIR DRAIN, REPAIR CONCRETE.
 - (09) PROVIDE AND INSTALL STAINLESS STEEL GRAB BARS AND WOOD BLOCKING. SEE ACCESSORY SCHEDULE.
 - (10) PROVIDE AND INSTALL 5' FIBERGLASS FRP WAINSCOT, 4 WALLS.
 - (11) PROVIDE AND INSTALL VINYL TILE FLOOR COVERING AND 4" RUBBER COVERED BASE.
 - (12) NEW FLOOR DRAIN GRATE.
 - (13) PROVIDE AND INSTALL NEW WATER SERVICE ENTRY IN NEW WALL. SEE DETAIL. INSTALL ALL PLUMBING IN WALLS BEFORE INSTALLING DRYWALL. PROVIDE 24" x 24" METAL ACCESS DOOR. TIE ELECTRICAL GROUND TO PLUMBING

- (14) PAINT WALL AND CABINETRY ON WEST WALL OF RADIO BAY.
- (15) 24" x 36" STAINLESS STEEL MIRROR. BOBRICK B-290 2436.
- (16) ABS, SURFACE MOUNTED SOAP DISPENSER. BOBRICK B-40 OR EQUAL.
- (17) CLEAR PLASTIC ROLL PAPER TOWEL DISPENSER. B-72860 OR EQUAL.
- (18) FLUORESCENT LIGHT FIXTURE.
- (19) PROVIDE AND INSTALL WALL HUNG LAVATORY AND FAUCET. SEE PLUMBING SCHEDULE.
- (20) HANDI-SHIELD LAVATORY WRAP BY PLUMBEREX OR EQUAL.
- (21) BOBRICK B-204-2 SHOWER CURTAIN, B-207-36 STAINLESS SHOWER CURTAIN ROD, 7 EACH 204-1 SHOWER CURTAIN HOOKS.
- (22) TOILET PAPER DISPENSER. BOBRICK B-5288, SURFACE MOUNTED ABS OR EQUAL.
- (23) PROVIDE AND INSTALL 150 CFM EXHAUST FAN AND DUCTWORK TO EXHAUST DIRECTLY OUT THE WALL TO OUTSIDE. PROVIDE GRILLE AND RODENT PROOF MESH OVER ENTRY.
- (24) PROVIDE AND INSTALL 2 EA. STAINLESS ROBE HOOK, BOBRICK B-670 OR EQUAL.

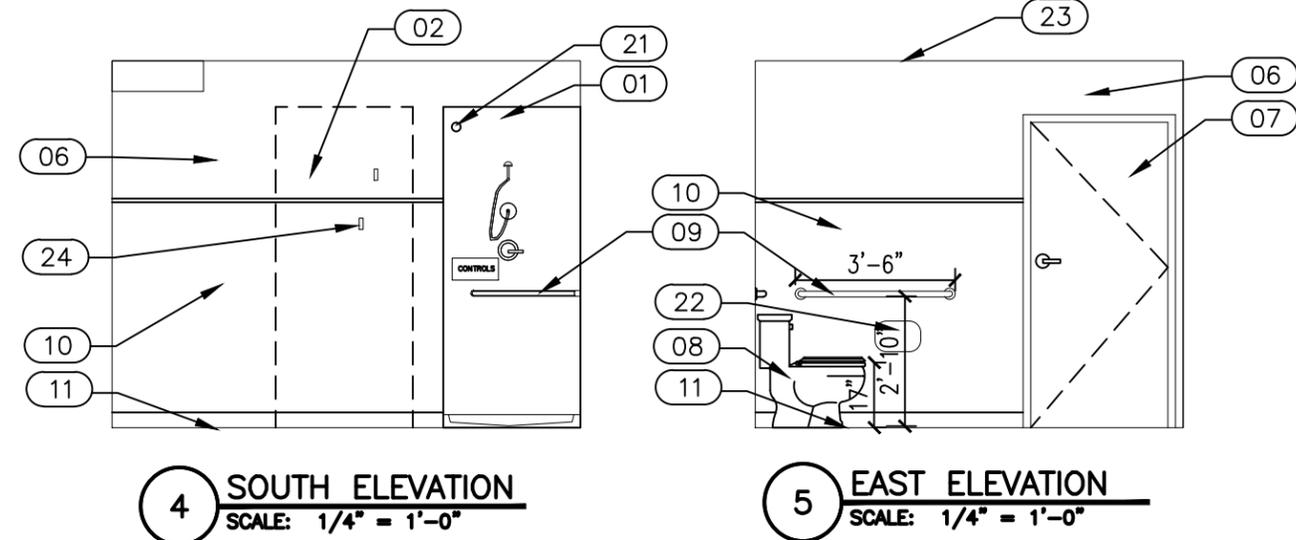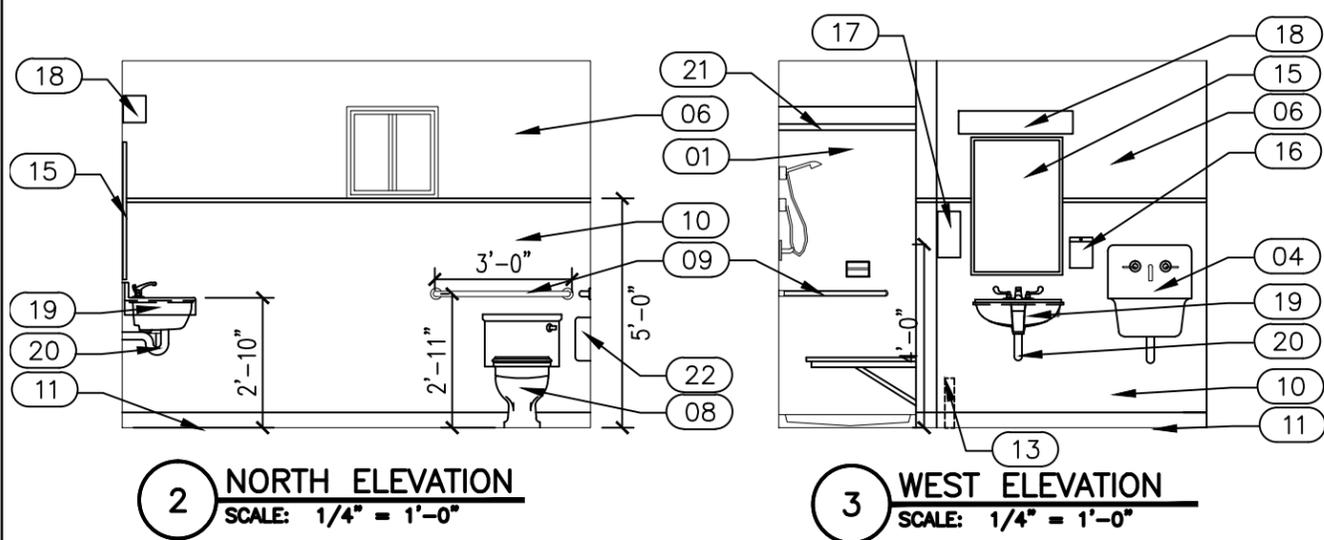


| | | |
|----------|-------------------|-----------------------|
| BY: SMHW | CHECK: D JEPPESEN | DATE |
| DESIGN | DRAWING | APPROVED: |
| BY: SMHW | CHECK: D JEPPESEN | DIRECTOR, ENGINEERING |


**PRICE YARD WAREHOUSE
 RESTROOM REMODEL**
 PLAN AND INTERIOR ELEVATION

PLUMBING FIXTURE SCHEDULE



| MARK | MANUFACTURER & MODEL | DESCRIPTION | GPM | CONNECTIONS | | | | REMARKS |
|--------------|--|---|-------------|-------------|------|--------------|--------|---|
| | | | | CW | HW | WASTE | VENT | |
| AG-1 | J.R. SMITH 395 IT | AIR GAP | -- | -- | -- | 1 1/2" | 1 1/2" | 3/4" INLET, 1 1/2" OUTLET |
| BFP-1 | WATTS ULF4007M2QTS | BACKFLOW PREVENTER | -- | 1" | -- | -- | -- | DOUBLE CHECK VALVE ASSEMBLY, LEAD FREE, STRAINER, UNIONS, QUARTER TURN BALL VALVES |
| FC0-1 | J. R. SMITH 4021S | FLOOR CLEANOUT | -- | -- | -- | SEE PLANS | -- | ROUND HEAD, GASKET SEAL-BRONZE PLUG |
| FD-1 | J. R. SMITH DX 2005Y(B)-NB | SQUARE HEAD FLOOR DRAIN | -- | -- | -- | 2" | 1 1/2" | NICKEL BRONZE STRAINER, WIDE FLANGE |
| LAV-1 | AMERICAN STANDARD #0124.131 SINK 7385.003 FAUCET | WALL HUNG LAVATORY  | 1.5 | 1/2" | 1/2" | 1 1/2" | 1 1/2" | SINGLE HANDLE FAUCET, CONCEALED ARM SUPPORT, PROTECTIVE ADA WRAP ON PIPES, GRID DRAIN |
| MV-1 | LEONARD TM-500A-IT | MIXING VALVE | 3.0 | 3/4" | 3/4" | -- | -- | 3/4" OUTLET, SET TO 80°F. INLET THERMOMETERS |
| SH-1 | AMERICAN STANDARD #1662.601 AQUATIC #1363BFC2P | HAND SHOWER ON SLIDE BAR  | 2.5 | 1/2" | 1/2" | 2" | 1 1/2" | PRESSURE BALANCE VALVE, HANDSHOWER, HOSE WALL SUPPLY, SLIDE BAR, 2 PIECE SHOWER SURROUND w/ BENCH & GRAB BARS, CENTER GRID DRAIN LOCATION |
| SH-2 | ELLA PLUS 24 ADA SHOWER ENCLOSURE | 4 PIECE FIBERGLASS SHOWER | -- | -- | -- | -- | -- | 38" X 38" X 79" WITH INTEGRAL SHOWER SEAT, GRAB BARS, DRAIN. |
| US-1 | MUSTEE 19CFT | UTILITY SINK | -- | 1/2" | 1/2" | 1 1/2" | 1 1/2" | 18 GALLON TUB, FAUCET, HOSE CONNECTIONS, P-TRAP, TOP COVER & STOPPER |
| WC-1 | AMERICAN STANDARD #211AA.104 | FLOOR MOUNTED WATER CLOSET  | 1.28 GPF | 1/2" | -- | 3" | 1 1/2" | ELONGATED BOWL, EVER CLEAN SURFACE FINISH, ADA HEIGHT BOWL, HANDLE ON WIDE SIDE |
| WH-1 | AO SMITH VOLTEX WATER HEATER | 50 GALLON, HYBRID | | | | | | MODEL HPTU-50 , ENERGY STAR RATED WATER HEATER. |

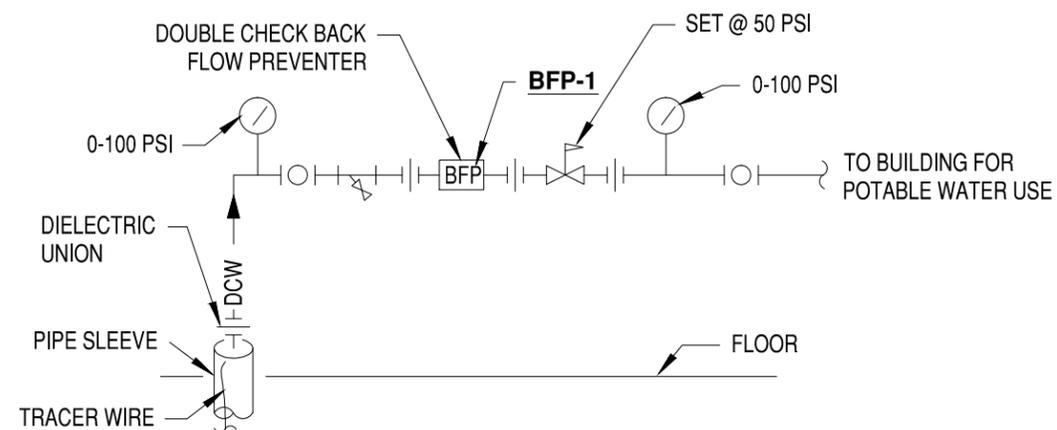


WATER SERVICE ENTRY DETAIL
NOT TO SCALE

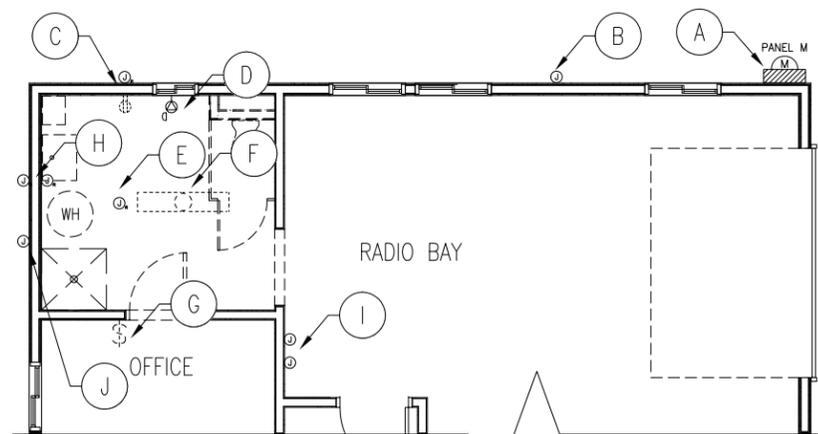

ELECTRICAL DEMOLITION FLOOR PLAN

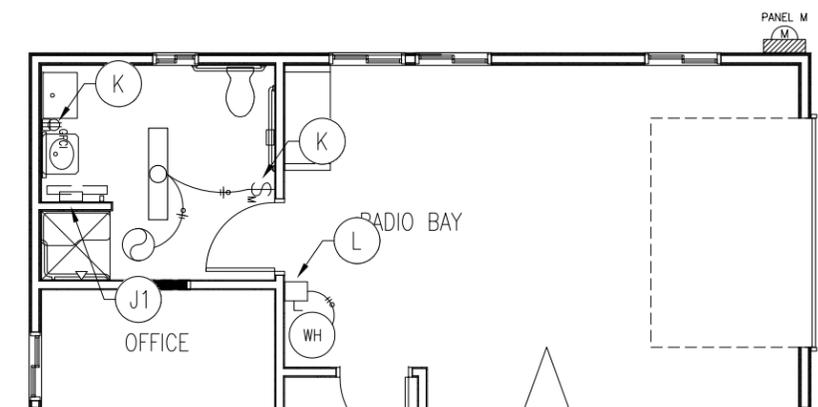

ELECTRICAL FLOOR PLAN



LEGEND

- PANEL A LOAD CENTER/ PANELBOARD WITH METER
- DISCONNECT, GENERAL DUTY, NOT SHOWN
- EXISTING JUNCTION BOX OR CONDUIT BODY TO REMAIN
- REMOVE EXISTING JUNCTION BOX OR CONDUIT BODY
- FAN - CEILING, 100 CFM, 1.5 SONES, MARLEY #7100A, DUCT TO EXTERIOR WITH 1117A WALL CAP
- REINSTALL SALVAGED FLOURESCENT LUMINAIRE, SURFACE MOUNT
- SALVAGE LUMINAIRE FOR REUSE
- SWITCH, OCCUPANCY DETECTOR, WATTSTOPPER PW-100-W, MANUAL ON/AUTO OFF, SET FOR 10 MINUTES
- RECEPTACLE, GFCI: COOPER; VGF20, HUBBELL; GFR5352L, PASS & SEYMOUR; 2095, OR, LEVITON; 7590
- BRANCH CIRCUIT: o - INDICATES GROUND, LONG LINE - "NUETRAL" OR "GROUNDED CONDUCTOR" AND THE SHORT LINE - "HOT" OR "LINE" CONDUCTORS

INSTALLATION NOTES


EXISTING COMBINATION METER MAIN DEVICE TO REMAIN. THE CIRCUITS ARE UNLABELED, INVESTIGATE AND LABEL ALL SIX CIRCUITS ACCORDING TO NEC 408.4. THE 100 AND 70 AMP BREAKERS ARE SUSPECTED TO FEED TWO PANELS IN AND ON BUILDING.

- (A) JUNCTION BOX WITH BUILDING ENTRY IN CIRCUIT C1, TO REMAIN.
- (B) JUNCTION BOX WITH BUILDING ENTRY IN CIRCUIT C1 TO BE REMOVED WITH BUILDING ENTRY REWORKED TO BE ABOVE CEILING LEVEL FOR FEEDING NEW LOCATIONS AND CONTINUING ON TO EXISTING LOADS THAT REMAIN WITHIN THE BUILDING.
- (C) ENTIRE EXPOSED CIRCUIT SHALL BE REMOUNTED ACCORDING TO NOTES BELOW.
- (D) REMOVE DRYER RECEPTACLE WITH ENTIRE CIRCUIT IN SHARED CONDUIT.
- (E) REMOVE ALL SURFACE MOUNTED CONDUIT AND CORRESPONDING CIRCUIT WITHIN THE RESTROOM.
- (E1) THE CIRCUIT "E" ABOVE LIKELY EXTENDS BEYOND THE RESTROOM AND LIGHT SWITCH, WHICH SURFACE MOUNTED CONDUIT AND CIRCUIT SHALL BE RECONNECTED FOR CONTINUED OPERATION.
- (F) REMOVE AND SALVAGE LUMINAIRE WITH LAMPS FOR REUSE.
- (G) REMOVE SURFACE MOUNTED SWITCH AND CONDUIT CIRCUIT.
- (H) REMOVE PENETRATION TO WATER HEATER AND WIRING FOR WATER HEATER.
- (H1) REWORK WATER HEATER CIRCUIT BACK TO NEW PENETRATION TO FEED WATER HEATERS NEW LOCATION. REPLACE BENT STICK (NEAR "C1" TAG). ENTIRE EXPOSED CIRCUIT SHALL BE REMOUNTED ACCORDING TO NOTES BELOW.
- (I) EXISTING CIRCUIT FEEDING TO OR FROM THE OFFICE TO REMAIN WITH LEFT JUNCTION BOX. REMOVE RIGHT JUNCTION BOX WHEN REWORKING AS IT DOES NOT FEED THROUGH THE WALL WHEN REWORKING THE CIRCUIT BELOW.
- (I1) REWORK CIRCUIT TO WALL TUCKING IN NEAR CEILING AND DROPPING STRAIGHT DOWN TO LEFT JUNCTION BOX.
- (I1) REPLACE/EXTEND CONDUCTORS AS NEEDED. NOTE: THE CIRCUIT DOES NOT FEED INTO THE LUMINAIRE SHOWN IN THE PHOTO.
- (J) ENTIRE EXPOSED CIRCUIT SHALL BE REMOUNTED ACCORDING TO NOTES BELOW. EXISTING FITTING HAS PARTED BELOW THE TWO RADIO BAY WINDOWS. METAL CONDUIT ENCLOSES GROUNDING ELECTRODE CONDUCTOR (GEC).
- (J1) BOND BOTH ENDS OF METAL CONDUIT SLEEVE TO GEC. RECONNECT GEC TO NEW WATER MAIN IN WALL, CONNECTION SHALL BE ACCESSIBLE THROUGH ACCESS DOOR.
- (K) CONNECT TO OLD CIRCUIT, REWORKED TO BE CONCEALED IN WALLS AND CEILING.
- (L) CONNECT TO OLD REWORKED, EXTENDED, AND CONCEALED WATER HEATER CIRCUIT.


- (M) ENTIRE EXPOSED CIRCUIT SHALL BE REMOUNTED ACCORDING TO NOTES BELOW. THIS CONDUIT SHALL BE MOUNTED BELOW CONDUIT IN "N."
- (M1) REPLACE DAMAGED EXPOSED CIRCUIT CONNECTING THESE TWO BODIES UNDER THIS WINDOW AND MOUNT ACCORDING TO NOTES BELOW.
- (N) ENTIRE EXPOSED CIRCUIT SHALL BE REMOUNTED ACCORDING TO NOTES BELOW. THIS CONDUIT SHALL BE MOUNTED ABOVE CONDUIT IN "M."

NOTES


1. REMOUNTED CIRCUITS SHALL BE PARALLEL AND PERPENDICULAR TO THE SIDING WITH CLAMPS INSTALLED WITHIN 36-INCHES OF BOTH SIDES OF EVERY CLAMP AND CHANGE OF DIRECTION. THIS IS BEYOND TYPICAL CODE CLAMPING REQUIREMENTS.
2. BUILDING PENETRATIONS NEW AND ABANDONED IN THIS CONTRACT SHALL BE FILLED AND SEALED WATERTIGHT WITH COLORIZED SILICON TO MATCH SIDING.
3. REWORKED CIRCUITS MAY USE ABANDONED, PAINTED EMT ON THE BUILDING EXTERIOR IF INSTALLED SO THAT IT LOOKS GOOD.
4. REWORKED CIRCUITS MAY USE EXISTING CONDUCTORS IF UNDAMAGED.

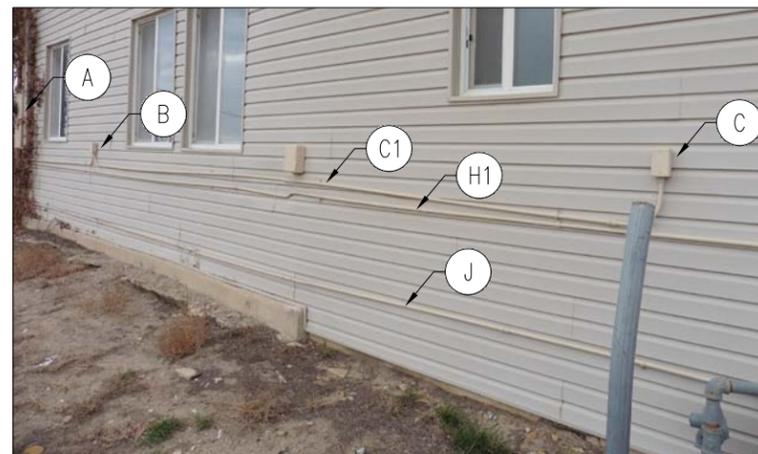


BUILDING EXTERIOR ON METER SIDE

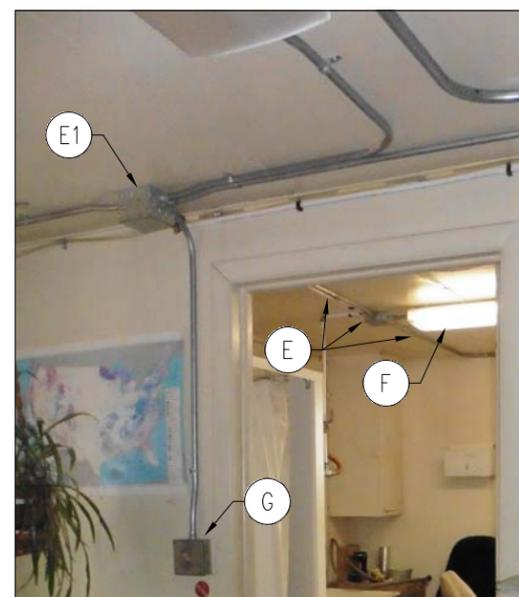


LOOKING INTO RESTROOM FROM OFFICE



WATER HEATER

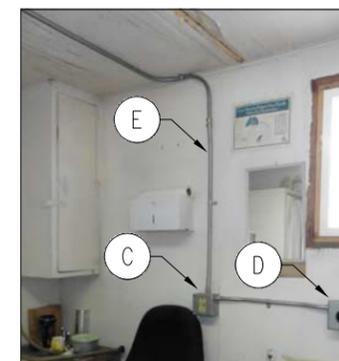

RESTROOM WALL

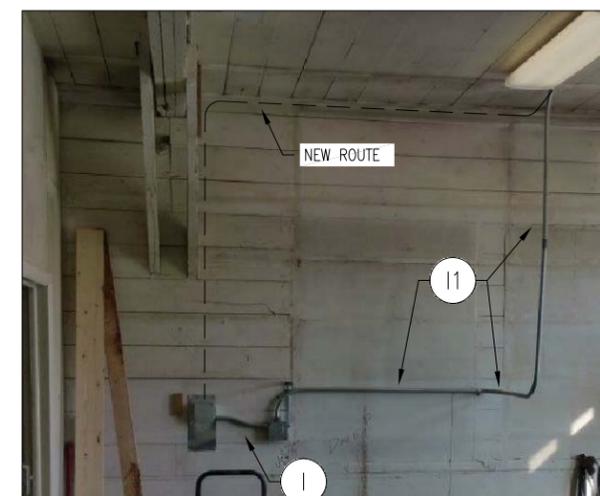

RADIO BAY WALL



BUILDING EXTERIOR ON SIDE OPOSITE OF METER SIDE



| | | |
|----------|-----------------------|-------------------|
| DESIGN | BY: S BROWN | CHECK: D JEPPESEN |
| DRAWING | BY: S BROWN | CHECK: D JEPPESEN |
| APPROVED | DIRECTOR, ENGINEERING | |
| | DATE: | |