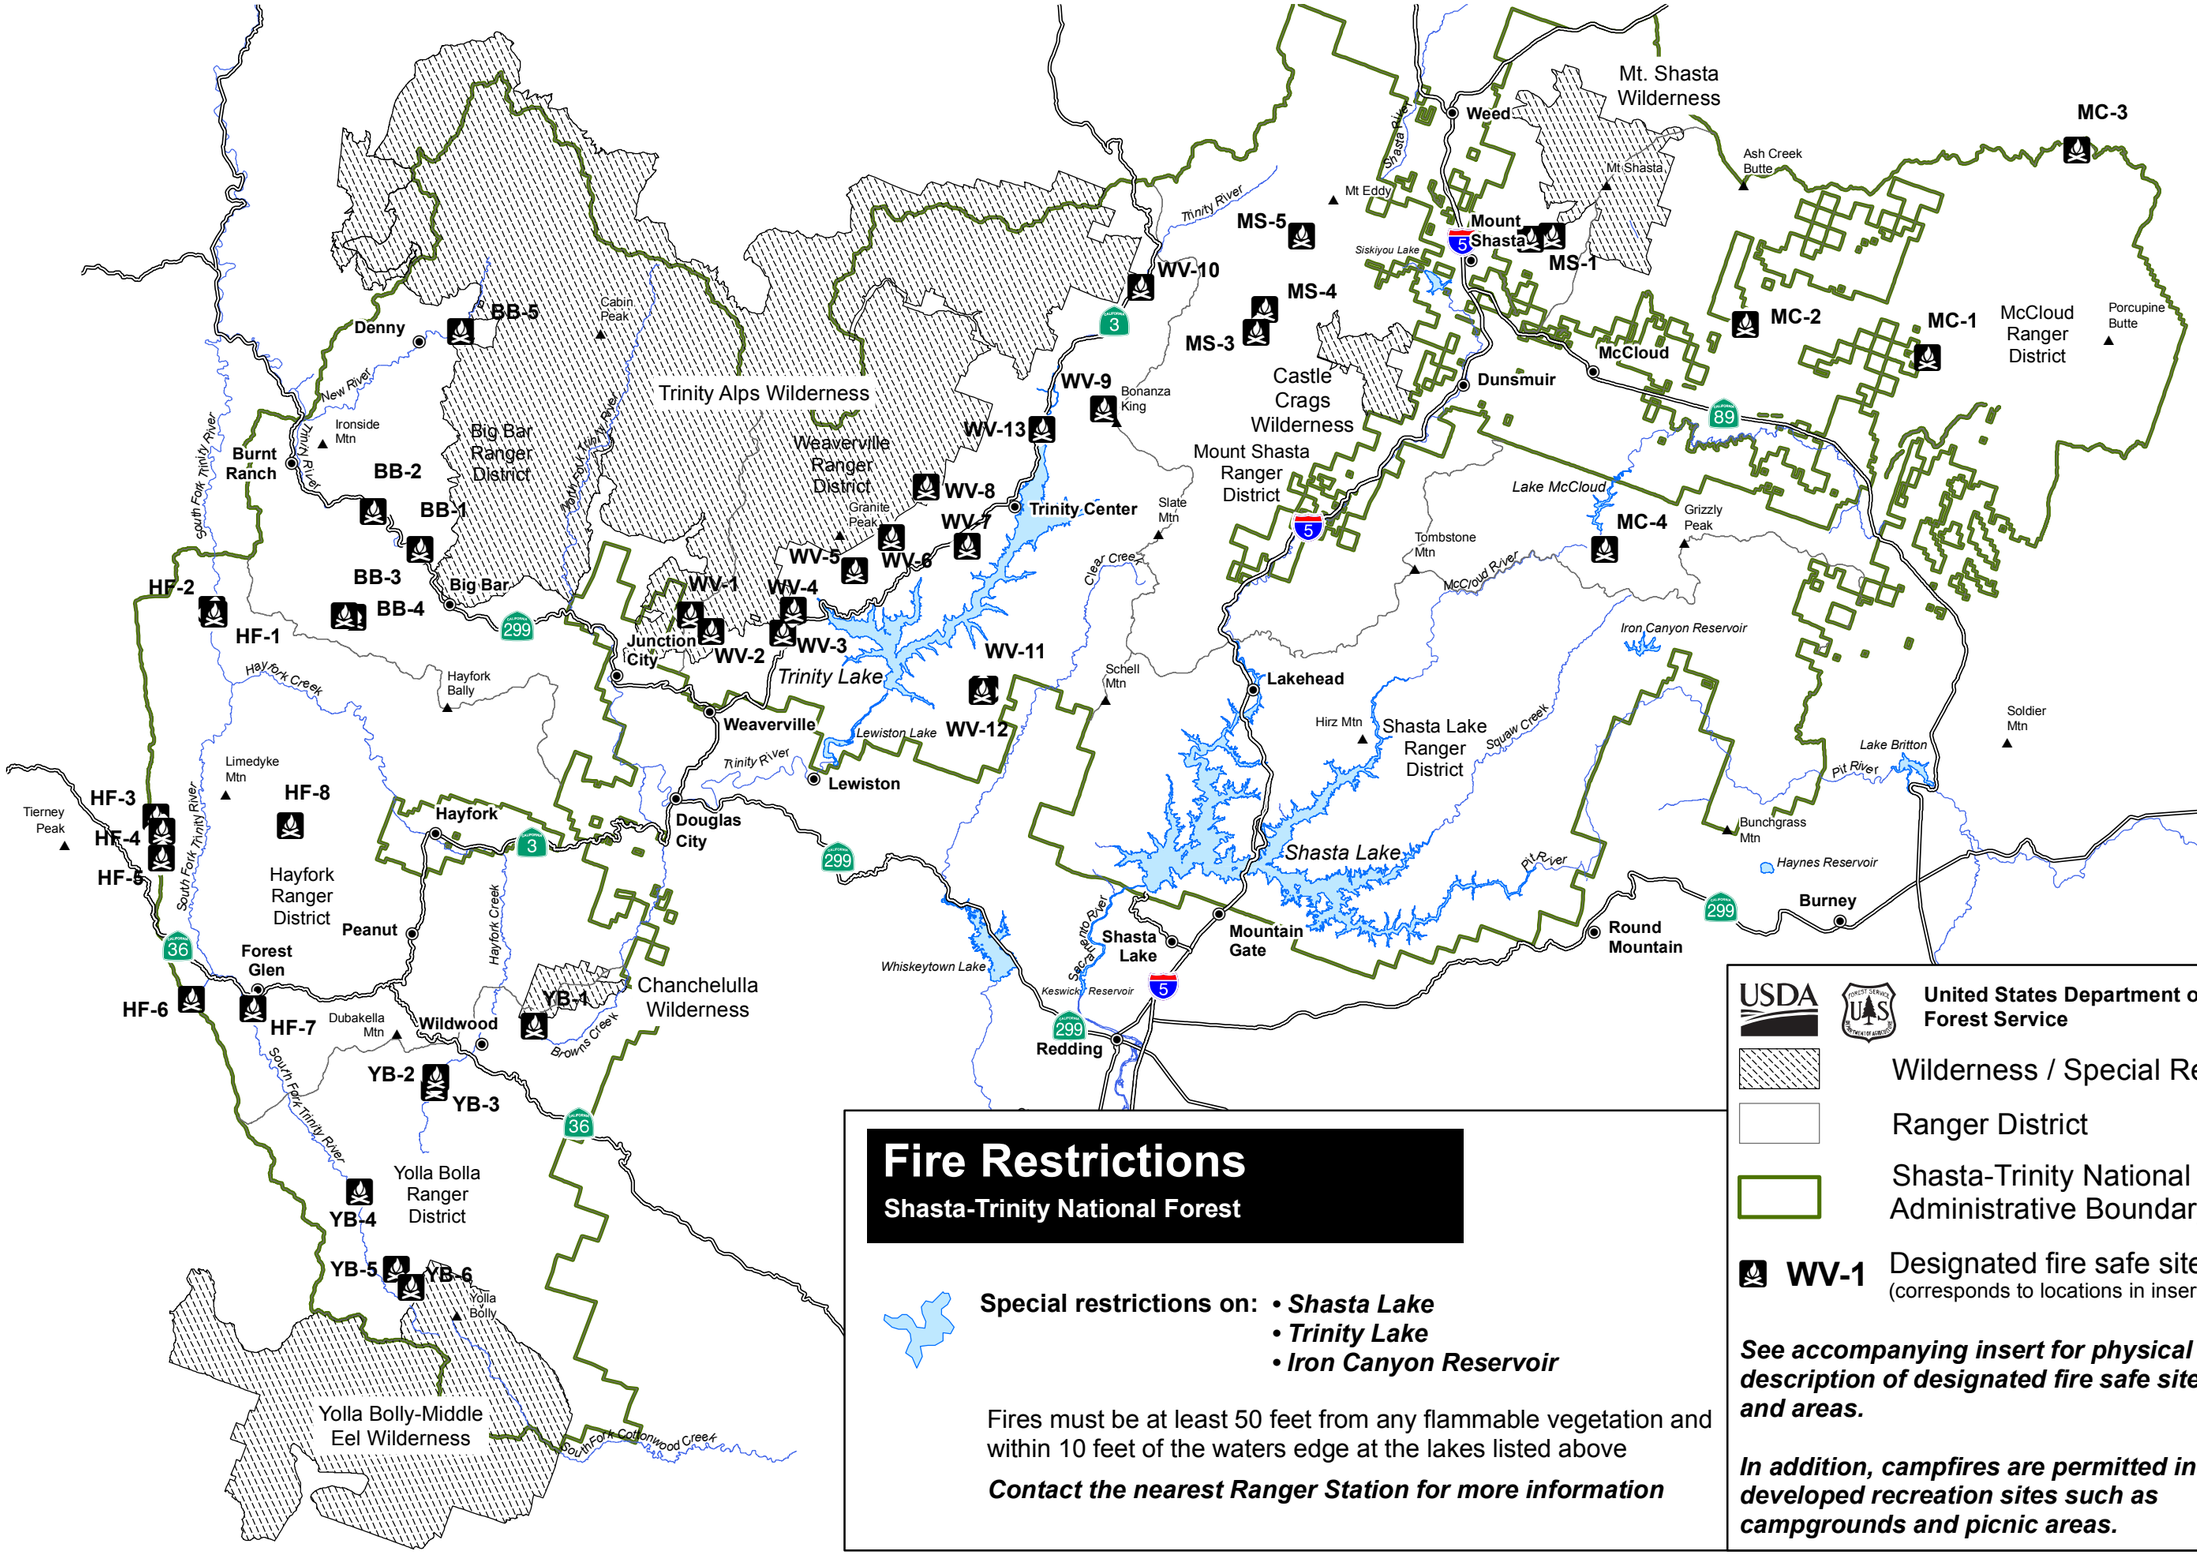

Fire Restrictions

Shasta-Trinity National Forest

Special restrictions on:
- ***Shasta Lake***
- ***Trinity Lake***
- ***Iron Canyon Reservoir***

Fires must be at least 50 feet from any flammable vegetation and within 10 feet of the waters edge at the lakes listed above

Contact the nearest Ranger Station for more information

United States Department of Agriculture
Forest Service

Wilderness / Special Restrictions Apply

Ranger District

Shasta-Trinity National Forest Administrative Boundary

WV-1 Designated fire safe sites (corresponds to locations in insert)

See accompanying insert for physical description of designated fire safe sites and areas.

In addition, campfires are permitted in developed recreation sites such as campgrounds and picnic areas.

N W E S

Not to Scale

Revised: 6-2015