

USFS OHARA BAR CAMPGROUND (PWS # 2250098) SOURCE WATER ASSESSMENT FINAL REPORT

March 20, 2002



State of Idaho Department of Environmental Quality

Disclaimer: This publication has been developed as part of an informational service for the source water assessments of public water systems in Idaho and is based on the data available at the time and the professional judgement of the staff. Although reasonable efforts have been made to present accurate information, no guarantees, including expressed or implied warranties of any kind, are made with respect to this publication by the State of Idaho or any of its agencies, employees, or agents, who also assume no legal responsibility for the accuracy of presentations, comments, or other information in this publication. The assessment is subject to modification if new data is produced.

Executive Summary

Under the Federal Safe Drinking Water Act Amendments of 1996, all states are required by the U.S. Environmental Protection Agency (EPA) to assess every source of public drinking water for its relative sensitivity to contaminants regulated by the Act. The Idaho Department of Environmental Quality (DEQ) is completing the assessments for all Idaho public drinking water systems. The assessment for your particular drinking water source is based on a land use inventory within a 1,000-foot radius of your drinking water source, sensitivity factors associated with the source, and characteristics associated with either your aquifer or watershed in which you live.

This report, *Source Water Assessment for USFS Ohara Bar Campground: Public Water System (PWS) #2250098* describes the public drinking water system, the associated potential contaminant sources located within a 1,000-foot boundary around the drinking water source, and the susceptibility (risk) that may be associated with any associated potential contaminants. This assessment should be used as a planning tool, taken into account with local knowledge and concerns, to develop and implement appropriate protection measures for this system. **The results should not be used as an absolute measure of risk and is not intended to undermine the confidence in your water system.**

The *USFS Ohara Bar Campground* drinking water system consists of two springs. The northwest spring is properly developed and is the main source of drinking water to the campground. The southeast spring needs to be redeveloped to deliver a better quality of drinking water. Both springs are located on a hill that slopes down toward the Selway River. The water from the springs is stored in two 500-gallon buried plastic tanks located within 50 feet of the springs. The water is then piped to a 1000-gallon buried plastic storage tank, which pipes the water to the campground. A chlorinating system is available but is rarely used.

Both springs rated low susceptibility to inorganic contaminants (IOCs), volatile organic contaminants (VOCs), synthetic organic contaminants (SOCs), and microbial contaminants. The limited number of potential contaminant sources and the predominant rangeland surrounding the springs contributed to the overall susceptibility of the system.

Though there are very few potential contaminant sources around the springs, testing for coliform bacteria resulted in repeat detections of total coliform bacteria in the distribution system. Most of these detections occurred during the month of August between 1993 and 2000, indicating a possible pathway for contamination from septic or surface contaminant sources.

The initial computer generated contaminant source inventory conducted by the DEQ did not locate any potential contaminant sources within the 1,000-foot boundary. However, the GIS map shows that the springs are located above the Selway River that lies within 1000-foot boundary of the delineation. This source was not used in assessing the susceptibility of the springs because the river is below the springs and therefore, does not pose a threat of contamination via surface runoff. A copy of the susceptibility analysis worksheet for your system along with a map showing any potential contaminant sources is included with this summary.

Susceptibility Analysis

The susceptibility of the source at the intake was ranked as high, moderate, or low risk according to the following considerations: hydrologic characteristics, physical integrity and construction of the intake, land use characteristics, and potentially significant contaminant sources. The susceptibility rankings are specific to a particular potential contaminant or category of contaminants. Therefore, a high susceptibility rating relative to one potential contaminant does not mean that the water system is at the same risk for all other potential contaminants. The relative ranking that is derived for each intake is a qualitative, screening-level step that, in many cases, uses generalized assumptions and best professional judgement. The following summaries describe the rationale for the susceptibility ranking.

System Construction

System construction directly affects the ability of the intake to protect the aquifer from contaminants. System construction scores are reduced when information shows that potential contaminants will have a more difficult time reaching the intake of the spring. Lower scores imply a system is less vulnerable to contamination. For example, if the intake structure of the surface water system is properly located and constructed to minimize impacts from potential contaminant sources, then the possibility of contamination is reduced and the system construction score goes down. If the system was constructed in a way that the infiltration gallery is separated from any surface water so as to provide some kind of natural filtration, the water quality is more protected and the system score is reduced.

The northwest spring of the USFS Ohara Bar Campground drinking water system rated low susceptibility for system construction and the southeast spring rated moderate susceptibility. Both springs are located on a hill above any surface water and outside of the 100-year flood plain, minimizing the impacts from potential contaminant sources. The 1996 sanitary survey indicates that the northwest spring is the only spring that is properly developed and constructed. Therefore, the southeast spring is not properly sealed to prevent contaminants from influencing the quality of the water. Fences surround both springs.

Potential Contaminant Source and Land Use

Both springs rated low for IOCs (e.g., arsenic, nitrate), VOCs (e.g., petroleum products), SOCs (e.g., pesticides), and microbial contaminants (e.g., bacteria). The limited number of potential contaminant sources and the predominant rangeland that surrounds the springs contributed to the low land use ratings.

Final Susceptibility Rating

Detections of IOCs above drinking water standard maximum contaminant levels (MCLs), a detection of total coliform bacteria, fecal coliform bacteria, or *E-coli* bacteria at the source, or a detection of an SOC or VOC in a water chemistry test will automatically give a high susceptibility rating for an intake despite the land use of the area because a pathway for contamination already exists. Compared to the system construction, land use is heavily weighted in the overall score. Therefore, even though the southeast spring had a moderate system construction score, the limited number of contaminant sources counteracted it resulting in a low

susceptibility. The overall susceptibility of both springs of the Ohara Bar Campground drinking water system is low.

Though there are very few potential contaminant sources around the springs, repeat detections of total coliform bacteria occurred in the distribution system. Most of these detections occurred during the month of August between 1993 and 2000, indicating a possible pathway for contamination from septic or surface contaminant sources.

Options for Drinking Water Protection

This assessment should be used as a basis for determining appropriate new protection measures or re-evaluating existing protection efforts. No matter what ranking a source receives, protection is always important. Whether the source is currently located in a “pristine” area or an area with numerous industrial and/or agricultural land uses, the way to ensure good water quality in the future is to act now to protect valuable water supply resources.

For USFS Ohara Bar Campground, drinking water protection activities should focus on correcting any deficiencies outlined in the Sanitary Survey (an inspection conducted every five years with the purpose of determining the physical condition of a water system’s components and its capacity). Due to the detection of total coliform bacteria in the distribution system within the water source, the disinfecting system should be updated and maintained. Partnerships with state and local agencies and industry groups should be established and are critical to success. You may want to establish a dialog with the relevant state and local agencies related to the efficient and correct protection of springs as a drinking water source. Drinking water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term.

Due to the time involved with the movement of ground water, drinking water protection activities should be aimed at long-term management strategies even though these strategies may not yield results in the near term. A strong public education program should be a primary focus of any drinking water protection plan. There are multiple resources available to help communities implement protection programs, including the Drinking Water Academy of the U.S. EPA. For areas where transportation corridors transect the delineation, the Department of Transportation should be included in protection activities. Drinking water protection activities for agriculture should be coordinated with the Idaho State Department of Agriculture, the Soil Conservation Commission, the local Soil Conservation District, and the Natural Resources Conservation Service.

Assistance

Public water suppliers and others may call the following DEQ offices with questions about this assessment and to request assistance with developing and implementing a local protection plan. In addition, draft protection plans may be submitted to the DEQ office for preliminary review and comments.

Lewiston Regional DEQ Office (208) 799-4370



State DEQ Office (208) 373-0502

Website: <http://www2.state.id.us/deq>

Water suppliers serving fewer than 10,000 persons may contact John Bokor, Idaho Rural Water Association, at 1-800-962-3257 for assistance with drinking water protection (formerly wellhead protection) strategies.

USFS Ohara Bar Campground: SE and NW Springs

PWS Number: 2250098

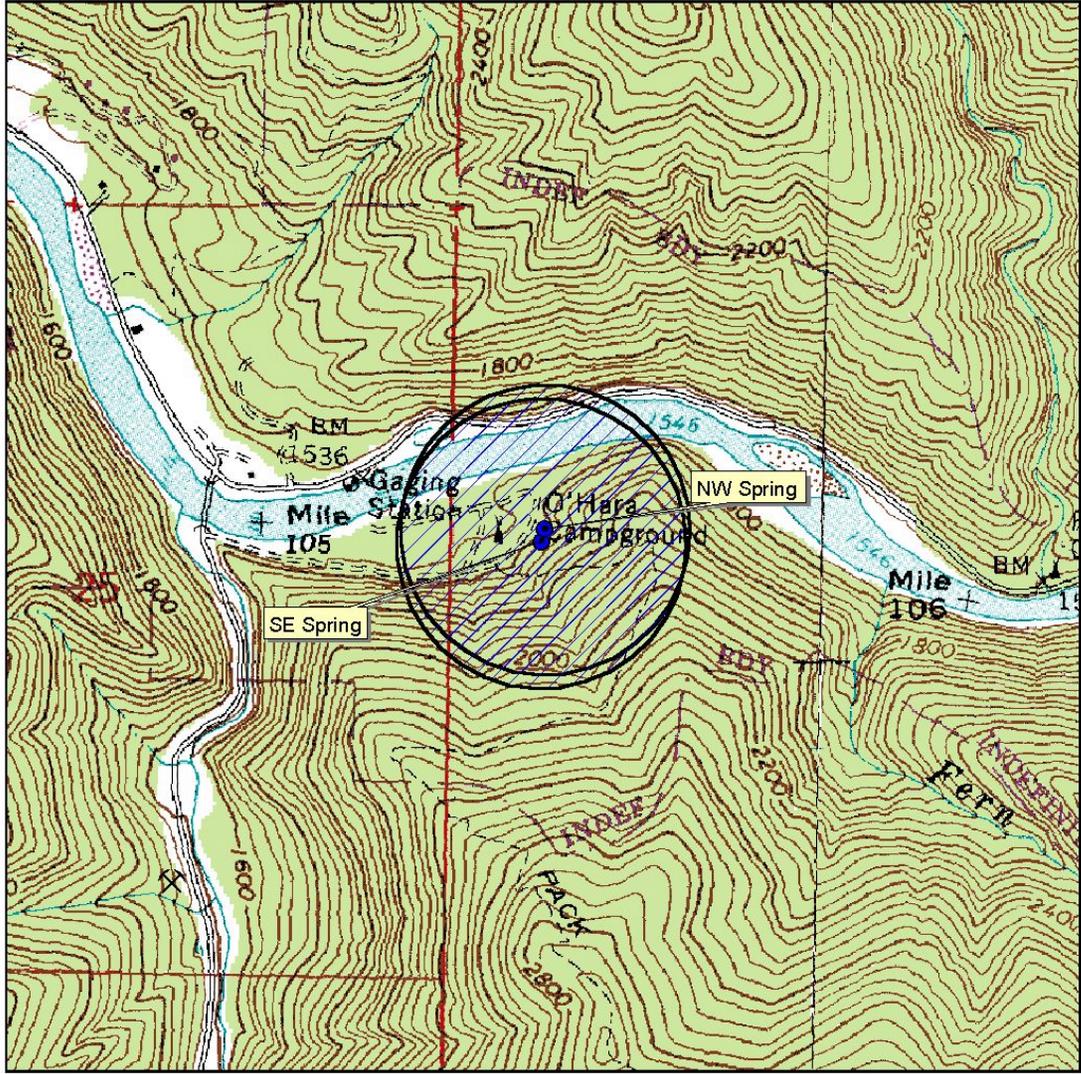

LEGEND



-  1B (3 yr TOT)
-  Wellhead
-  Enhanced Inventory
-  CERCLIS Site
-  RICRIS Site
-  Dairy
-  LUST Site
-  Closed UST Site
-  Open UST Site
-  Business Mailing List
-  NPDES Site
-  Mine
-  AST
-  Toxic Release Inventory
-  SARA Title III Site (EPCRA)
-  Recharge Point
-  Injection Well
-  Group1 Site
-  Cyanide Site
-  Landfill
-  Wastewater Land App.Site

Restriction of Liability:
 Neither the State of Idaho nor the Idaho Department of Environmental Quality, nor any of their employees make any warranty, express or implied, or assume any legal liability or responsibility for the accuracy, completeness or usefulness of any information or data provided. Metadata is provided for all data sets, and no data should be used without first reading and understanding its limitations. The data could include technical inaccuracies or typographical errors. The Department of Environmental Quality may update, modify, or revise the data used at any time, without notice.



POTENTIAL CONTAMINANT INVENTORY LIST OF ACRONYMS AND DEFINITIONS

AST (Aboveground Storage Tanks) – Sites with aboveground storage tanks.

Business Mailing List – This list contains potential contaminant sites identified through a yellow pages database search of standard industry codes (SIC).

CERCLIS – This includes sites considered for listing under the **Comprehensive Environmental Response Compensation and Liability Act (CERCLA)**. CERCLA, more commonly known as **Superfund**, is designed to clean up hazardous waste sites that are on the national priority list (NPL).

Cyanide Site – DEQ permitted and known historical sites/facilities using cyanide.

Dairy – Sites included in the primary contaminant source inventory represent those facilities regulated by Idaho State Department of Agriculture (ISDA) and may range from a few head to several thousand head of milking cows.

Deep Injection Well – Injection wells regulated under the Idaho Department of Water Resources generally for the disposal of stormwater runoff or agricultural field drainage.

Enhanced Inventory – Enhanced inventory locations are potential contaminant source sites added by the water system. These can include new sites not captured during the primary contaminant inventory, or corrected locations for sites not properly located during the primary contaminant inventory. Enhanced inventory sites can also include miscellaneous sites added by the Idaho Department of Environmental Quality (IDEQ) during the primary contaminant inventory.

Floodplain – This is a coverage of the 100-year floodplains.

Group 1 Sites – These are sites that show elevated levels of contaminants and are not within the priority one areas.

Inorganic Priority Area – Priority one areas where greater than 25% of the wells/springs show constituents higher than primary standards or other health standards.

Landfill – Areas of open and closed municipal and non-municipal landfills.

LUST (Leaking Underground Storage Tank) – Potential contaminant source sites associated with leaking underground storage tanks as regulated under RCRA.

Mines and Quarries – Mines and quarries permitted through the Idaho Department of Lands.)

Nitrate Priority Area – Area where greater than 25% of wells/springs show nitrate values above 5mg/l.

NPDES (National Pollutant Discharge Elimination System) – Sites with NPDES permits. The Clean Water Act requires that any discharge of a pollutant to waters of the United States from a point source must be authorized by an NPDES permit.

Organic Priority Areas – These are any areas where greater than 25 % of wells/springs show levels greater than 1% of the primary standard or other health standards.

Recharge Point – This includes active, proposed, and possible recharge sites on the Snake River Plain.

RICRIS – Site regulated under **Resource Conservation Recovery Act (RCRA)**. RCRA is commonly associated with the cradle to grave management approach for generation, storage, and disposal of hazardous wastes.

SARA Tier II (Superfund Amendments and Reauthorization Act Tier II Facilities) – These sites store certain types and amounts of hazardous materials and must be identified under the Community Right to Know Act.

Toxic Release Inventory (TRI) – The toxic release inventory list was developed as part of the Emergency Planning and Community Right to Know (Community Right to Know) Act passed in 1986. The Community Right to Know Act requires the reporting of any release of a chemical found on the TRI list.

UST (Underground Storage Tank) – Potential contaminant source sites associated with underground storage tanks regulated as regulated under RCRA.

Wastewater Land Applications Sites – These are areas where the land application of municipal or industrial wastewater is permitted by IDEQ.

Wellheads – These are drinking water well locations regulated under the Safe Drinking Water Act. They are not treated as potential contaminant sources.

NOTE: Many of the potential contaminant sources were located using a geocoding program where mailing addresses are used to locate a facility. Field verification of potential contaminant sources is an important element of an enhanced inventory.

Where possible, a list of potential contaminant sites unable to be located with geocoding will be provided to water systems to determine if the potential contaminant sources are located within the source water assessment area.

The final scores for the susceptibility analysis were determined using the following formulas:

1) VOC/SOC/IOC Final Score = Intake Construction + (Potential Contaminant/Land Use x 0.273)

2) Microbial Final Score = Intake Construction + (Potential Contaminant/Land Use x 0.35)

Final Susceptibility Scoring:

0 - 7 Low Susceptibility

8 - 15 Moderate Susceptibility

16 -21 High Susceptibility

1. System Construction

SCORE

Intake structure properly constructed	YES	0
Infiltration gallery or well under the direct influence of Surface Water	YES	2

Total System Construction Score 0

2. Potential Contaminant Source / Land Use

IOC Score VOC Score SOC Score Microbial Score

Predominant land use type (land use or cover)	BASALT FLOW, UNDEVELOPED, OTHER	0	0	0	0
Farm chemical use high	NO	0	0	0	
Significant contaminant sources *	NO				
Sources of class II or III contaminants or microbials	not present	0	0	0	0
Agricultural lands within 500 feet	NO	0	0	0	0
Three or more contaminant sources	NO	0	0	0	0
Sources of turbidity in the watershed	NO	0	0	0	0

Total Potential Contaminant Source / Land Use Score 0 0 0 0

3. Final Susceptibility Source Score

0 0 0 0

4. Final Source Ranking

Low Low Low Low

* Special consideration due to significant contaminant sources
The source water has no special susceptibility concerns

1. System Construction

SCORE

Intake structure properly constructed	NO	1
Infiltration gallery or well under the direct influence of Surface Water	YES	2

Total System Construction Score 1

2. Potential Contaminant Source / Land Use

IOC Score VOC Score SOC Score Microbial Score

Predominant land use type (land use or cover)	BASALT FLOW, UNDEVELOPED, OTHER	0	0	0	0
Farm chemical use high	NO	0	0	0	
Significant contaminant sources *	NO				
Sources of class II or III contaminants or microbials	not present	0	0	0	0
Agricultural lands within 500 feet	NO	0	0	0	0
Three or more contaminant sources	NO	0	0	0	0
Sources of turbidity in the watershed	NO	0	0	0	0

Total Potential Contaminant Source / Land Use Score 0 0 0 0

3. Final Susceptibility Source Score

1 1 1 1

4. Final Source Ranking

Low Low Low Low

* Special consideration due to significant contaminant sources
The source water has no special susceptibility concerns