

DEPARTMENT OF AGRICULTURE
 FOREST SERVICE
 REGION 9
 ALLEGHENY NATIONAL FOREST

Hemlock Stewardship Project No. 012

Bean Fields Wildlife Corridor Water and Soil Rehabilitation – 1.2 Miles of Main Corridor
Bean Fields Wildlife Corridor Water and Soil Rehabilitation – 0.8 Miles of Old Irvine Estate Corridor

Bradford Ranger District
 Warren County
 Pennsylvania

Hemlock Stewardship Project No. 012	1
Vicinity Map.....	2
Schedule of Items	3
General Notes	4
Corridor Log - Work Descriptions	5
Corridorbed Details	8

The location and design elements of this facility have been correlated with the plans, policies and constraints of the approved Meads Mill Environmental Assessment.

Plans are to be used with "Standard Specifications for Construction of Roads and Bridges on Federal Highway Projects FP-03 with Special Project Specifications thereto included in this contract.

Prepared By:

Ivan E. Martinez

Approved By:



4/5/13

District Ranger

Date



4-5-2013

Forest Engineer

Date



4/5/2013


Forest Supervisor

Date

Hemlock Stewardship Project No. 12 Bean Fields Wildlife Corridor


Excess Waste Disposal Areas

Excess Waste Disposal Areas

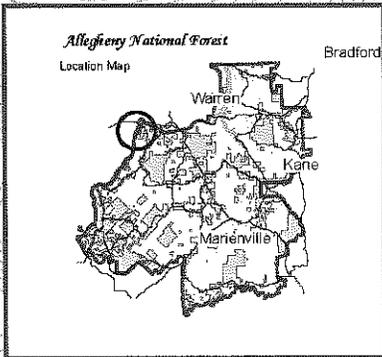

1:15,000

20130405 lem

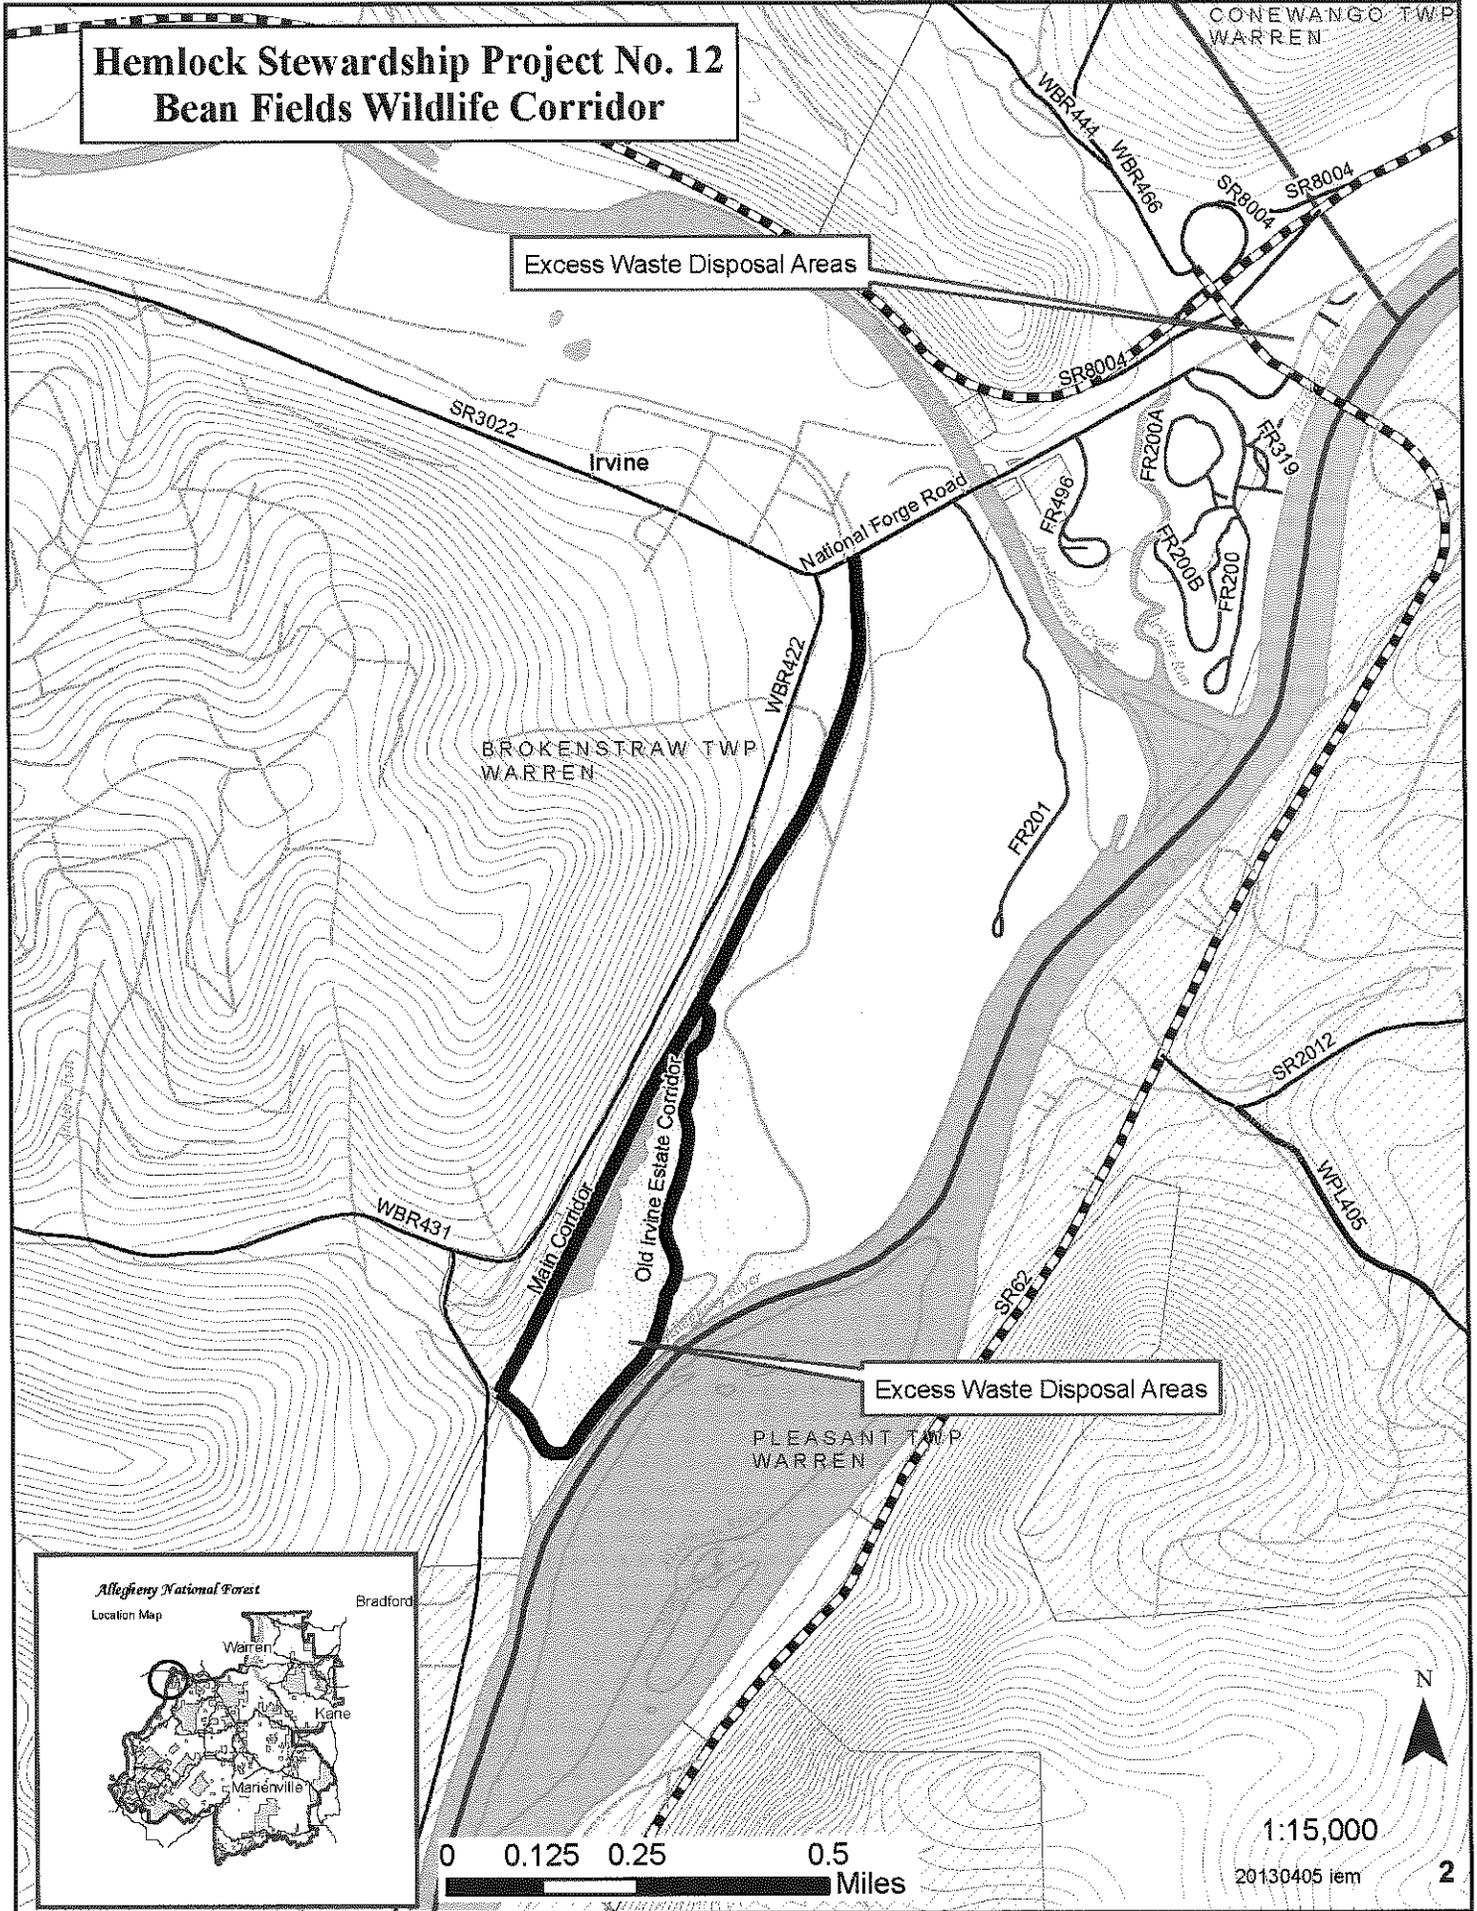

Schedule of Items

Bean Fields Wildlife Main Corridor

Item	Description	Unit	Quantity
15101	Mobilization (Lump Sum)	All	1
20301	Removal of culverts	Each	5
20412	Ditch line excavation and waste excavation disposal	Linear Foot	1576
20701	Earthwork geotextile Type II nonwoven for separation	Square Yard	903
23050	Brushing (spot brushing)	Mile	0.5
25102	Placed riprap, class R-4	Ton	3
30101	Aggregate base, grading PA-2A, compaction method B	Ton	182
30115	Aggregate surface course, Type 1" minus, compaction method B	Ton	692
30326	Corridor reconditioning (dozer)	Mile	1.2
60201	16" steel pipe casing	Foot	124
60201	22" steel pipe casing	Foot	168
60263	36 inch aluminized steel, type 2, corrugated steel pipe, 0.079 inch thickness, method A	Linear Foot	20
62501	Seeding, hydraulic or dry method (Lump Sum)	All	1
65003	Gate Repair	Each	2

Bean Fields Wildlife Old Irvine Estate Grounds Corridor

Item	Description	Unit	Quantity
15101	Mobilization (Lump Sum)	All	1
20405	Excavation and waste excavation disposal	Cubic Yard	8
20701	Earthwork geotextile type nonwoven	Square Yard	35
23050	Brushing (spot brushing)	Mile	0.3
25102	Placed riprap, class R-4	Ton	14
30101	Aggregate base, grading #3 rock, compaction method B	Ton	5
30115	Aggregate surface course, Type 1" minus, compaction method B	Ton	81
62501	Seeding, hydraulic or dry method (Lump Sum)	All	1

General Notes

-Prior to any earth disturbing activities, contractor shall call the Pennsylvania One Call System (800-242-1776) and all Oil & Gas Operators in the work area to determine locations of any underground utility lines.

- Typical construction equipment and highway trucks will not be used to complete this project work description.

- Ditch excavated material will be hauled to waste areas along the corridor designated by inspector.

- Designated waste area #1 for excess material is at corridor across from the Buckaloons residence, waste area #2 is at opening along the Old Irvine Estate Grounds Corridor; shown on the map.

-Culvert cleaning and repair will be considered incidental to corridor reconditioning.

-Contractor is responsible for maintenance of all Forest Service roads over which pit run or commercial stone material is hauled. Roads shall be bladed or shaped to restore travel way to the condition found prior to haul.

-Contractor shall install "ROAD CLOSED, TRUCK TRAFFIC and ROAD CONSTRUCTION AHEAD" signs on all roads worked on in this project. Signs shall conform to the Manual on Uniform Traffic Control Devices (MUTCD). Signs shall be covered when construction activity is not taking place.

-All removed corrugated metal pipe culverts shall be hauled off Federal lands and become the property of the contractor. Steel pipe casings shall be returned to the Sheffield Work Center unless otherwise directed by the Engineer.

-Forest Service gate plans are available at the Allegheny National Forest Supervisor's Office, Warren, PA. 16365. The following are gate manufacturers:

Gary Asel
Marienville, PA.
(814) 927-8380

ADM Welding
2818 Penna. Ave. West
Warren, PA. 16365
(814) 723-7227

-Please see gate typical drawing for gate signs required.

-Contouring, topsoil respreading, seeding and mulching of disturbed areas as determined by the Forest Service is required.

-When replacing culverts in live streams, contractor shall install silt fence and straw bales at approaches to live stream crossings to eliminate sediment in the stream course. When culverts are located on High Quality and Exceptional Value streams, contractor shall install compost filter socks. Any sediment collected will be removed and ground will be stabilized with seed and mulch. Dewatering pumps will be used to redirect water out of the stream course at the time of stream crossing installation. Silt fence and straw bales will be removed only after vegetation is clearly re-established as determined by the Engineer.

-Corridor sod encountered during corridor reconditioning operations will be spread and leveled outside the road template avoiding piles. Natural terrain depressions and openings are the preferred waste locations. Seeding and mulching may be required to supplement natural revegetation.

-Vegetation cut down during roadside brushing will be pulled beyond the clearing limits and the toe of any roadway template construction. Mixing of soil and cut vegetation shall be avoided. All material will be scattered and lopped within 3' of the ground.

Corridor Log - Work Descriptions
Bean Fields Wildlife Corridor – Water and Soil Rehabilitation

Station	Road Log/Work Description
0+00	Intersection with SR 3022 (National Forge Rd)
<u>Corridor objective:</u> Hiking trail and corridor access for maintenance equipment such as boom mower, small dozer, mini- excavator, tracked rock hauler; corridor surface must be able to support equipment load. <u>Utilize small narrow equipment to complete this primitive trail.</u>	
Note: Typical construction equipment and highway trucks will not be used to complete this project work description. Trail start and termini are designated as stockpile locations (south stockpile location on existing parking area east side of SR 3022, south of stream)	
0+00 – 63+80	Corridor dozer reconditioning (clearing and grubbing woody/organic debris)
0+00 – 63+80	Spot bushing (includes removal of brush/debris/logs on/along corridor place beyond clearing limits. Corridor brushing segments shall be identified by inspector); estimated total = 0.5 miles. See spot brushing drawing.
0+55	Repaint Forest Service gate
3+40 – 3+70	Old stone/concrete bridge, 25 ft. span, 30 ft. width. Bridge inspected by Greg Potter; see report.
8+60 – 9+25	Pond right
12+20	Block illegal ATV trail right
12+54	Remove tree from corridor
13+60 – 14+20	Remove debris/brush pile, right, move back 20 ft. and scatter
15+70	Remove 20" x 12' steel casing, install 36" x 20' CMP, apply 18 tons of PA-2A, excavate 30 ft north and south of inlet. Note: All steel casings removed from project will be returned to Sheffield Work Center.
16+15	Remove tree from corridor
17+15	12" x 30' steel casing
21+25 – 25+70	Excavate ditchline, right to drain
23+10	15" x 30' steel casing
23+45	Remove tractor tire
24+67	Remove standing tree, right
24+70	Construct drivable broad base dip with gradual approaches 1' deep; 30' approaches
24+95 – 25+70	Apply 4" of 1" minus (12 ft. corridor width) (23 tons); prepare corridor for surface material placement by clearing and grubbing woody/organic debris
25+30	Construct drivable broad base dip with gradual approaches 1' deep; 30' approaches
25+62	Remove standing tree, right
26+93	Remove tire

28+50 Clean 10" x 38' steel casing. Remove culvert, clean, shake to remove debris out and reinstall; remove standing trees at outlet

29+05 – 31+05 Apply 4" of 1" minus surfacing (58 tons); excavate right ditch line to drain water into culvert at 29+90; prepare corridor for surface material placement by clearing and grubbing woody/organic debris

29+90 Install 22" x 38' steel casing, align with stream, level outlet to ground, apply 18 tons of PA-2A

31+05 Existing 12"x 18' steel casing, spring right, clean outlet

32+30 Existing 8" x 25' steel casing, clean inlet, apply 3 ton R-4 at outlet

32+90-33+70 Apply 23 tons of 1" minus surfacing

33+00 Road/trail left (trail loop)

33+30 Install 22" x 48' steel casing left forward skew, 18 tons of PA-2A; align with major spring, excavate right ditch line to drain multiple streams into culvert (outlet should be placed between (2) hickory trees and (1) cucumber tree)

34+65 Remove 12"x 18' steel casing, install 16" x 26' steel casing, apply 18 tons of PA-2A

34+65 – 36+62 Apply 4" of 1" minus surfacing (57 tons); excavate ditch line, right; prepare corridor for surface material placement by clearing and grubbing woody debris and organic material

36+62 Existing 12" x 16' steel casing, clean inlet

37+80 – 44+30 Apply 10" of 1" minus surfacing (488 tons); excavate ditch line, right; prepare corridor for surface material placement by clearing and grubbing woody debris, under cut trail 6" deep, waste material along corridor; place geotextile fabric.

39+50 Install 16" x 22' steel casing, apply 18 tons of PA-2A

40+90 Remove 16" (buried) steel casing, install 22" x 30' steel casing, apply 18 tons PA-2A

42+70 Install 16" x 26' steel casing, apply 18 tons PA-2A

43+18 Install 22" x 26' steel casing, apply 18 tons PA-2A

43+40 Install 22" x 26' steel casing, apply 18 tons PA-2A

47+93 Remove brush/debris, push back 25 ft. into the woods

49+55 Remove 12" x 17' steel casing, install 16" x 24' steel casing, apply 18 tons PA-2A, excavate outlet ditch

50+95 Remove brush/debris, push back 25 ft. into the woods

54+00 – 55+00 Remove blow down logs/debris, push back 25 ft. into the woods

55+70 Apply 2 tons of PA-2A to fill in root bowl (10'x 2'x 1.5')

58+50 – 60+00 Apply 4" of 1" minus surfacing (43 tons); prepare corridor for surface material placement by clearing and grubbing woody debris and organic material

58+50 Install 16" x 26' steel casing, apply 18 tons of PA-2A

63+20 Repaint Forest Service gate

63+80 Stone house right, end of road, parking area, intersection with WB 422 (Dunns Eddy Road)

Bean fields Wildlife Corridor to Old Irvine Estate Grounds

Station	Road Log/Work Description
0+00	Intersection with corridor/rail road grade (near stone house) Township road

Corridor objective: Hiking trail and corridor access for maintenance equipment such as boom mower, small dozer, mini- excavator, tracked rock hauler; corridor surface must be able to support equipment load. **Utilize small narrow equipment to complete this primitive trail.**
Note: Typical construction equipment and highway trucks will not be used to complete this project work description.

0+00 – 42+15	Spot bushing (includes removal of brush/debris/logs on/along corridor place beyond clearing limits. Corridor brushing segments shall be identified by inspector); estimated total = 0.3 miles. See spot brushing drawing.
--------------	---

7+20	Remove blow down logs/debris, push back 25 ft into the woods
8+90	Remove blow down logs/debris, push back 25 ft into the woods
13+00	Remove blow down logs/debris, push back 25 ft into the woods
13+65	Brushing and remove logs off corridor/trail
18+90	Road/trail right (dead end), trail continues left
20+70	Remove blow down logs/debris, push back 25 ft into the woods
25+75	Remove blow down logs/debris, push back 25 ft into the woods


39+65 – 39+90	Construct French mattress to maintain existing pond spillway/overflow conditions (<u>DO NOT drain south pond when constructing mattress</u>) (8 ft. corridor width), excavate/under cut 10” deep, waste material along corridor; lay heavy duty separation fabric, leave enough fabric on the ends to wrap around; place 12” of riprap R-4 (14 tons); place 4” of #3 gravel (5 tons); lay heavy duty separation fabric (See special project specification 25308 for more details)
---------------	--

39+00 – 39+90	Apply 4” of 1” minus surfacing (17 tons; includes French mattress surfacing)
---------------	--


39+90 – 42+15	Apply 6” of 1” minus surfacing (64 tons; 8 ft running surface)
---------------	--

42+15	End of trail intersects with main wildlife corridor
-------	---


Corridorbed Details

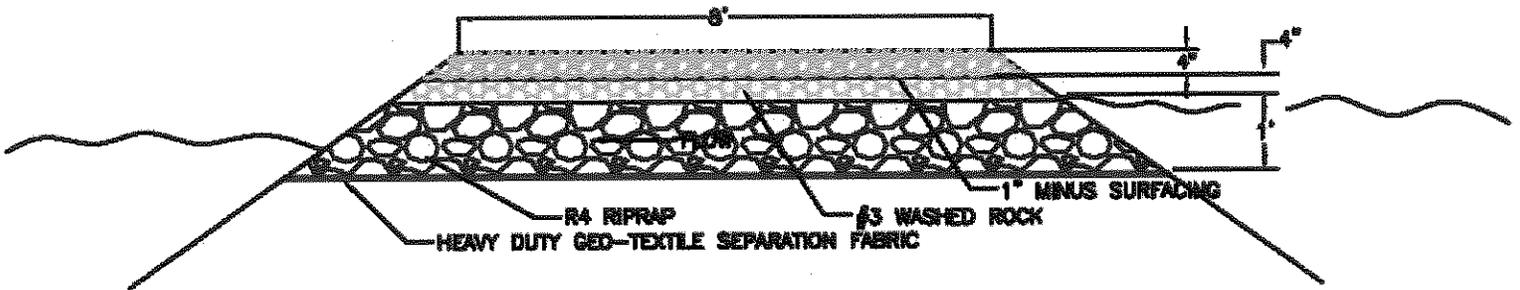


FRENCH MATTRESS
CROSS SECTION VIEW

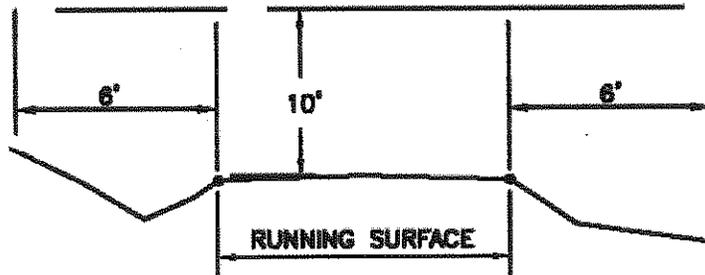

CORRIDOR BRUSHING DETAIL

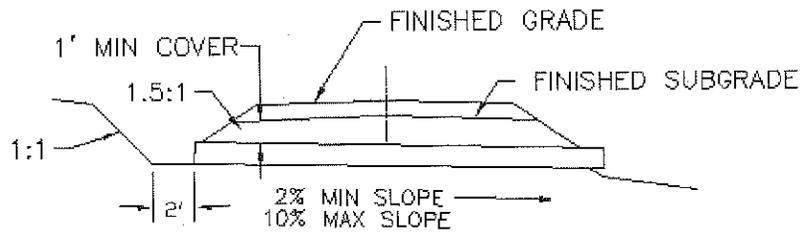


CULVERT SECTION

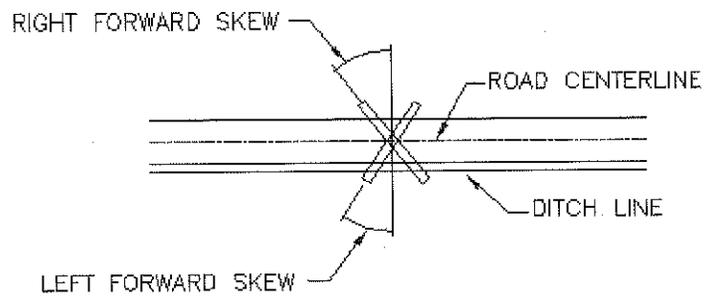

SKEW DETAIL

NOTE: Field locate ditch to minimize new clearing

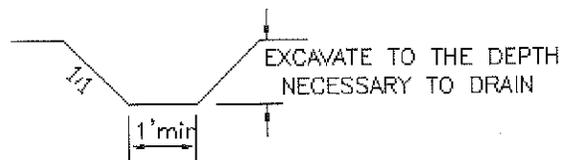

OUTLET/LEAD OFF DITCH SECTION

GENERAL NOTES


- ALL STEEL SHALL BE PAINTED WITH (2) COATS OF IRON OXIDE RED PRIMER AND (1) COAT OF WALNUT BROWN PAINT, FED. STANDARD 593 A PAINT NO. 20140 (EXCEPT PIVOT TUBE)
- ALL STEEL SHALL BE NEW MATERIAL
- WELD ALL CROSS ARM ASSEMBLY JOINTS WITH 3/16" FILLETS ALL AROUND ALL WELDS ON GATE ASSEMBLY SHALL BE STRUCTURALLY SOUND
- DRILL 1/4" DIAMETER HOLES 4" ON CENTER IN BOTTOM OF CROSS ARM TO FACILITATE DRAINAGE.
- APPLY GREASE TO OUTSIDE OF PIVOT TUBE, ENTIRE LENGTH, PRIOR TO INSTALLATION OF CROSS ARM ASSEMBLY. TYPE OF GREASE SHALL BE EXTREME PRESSURE MULTIPURPOSE WHEEL BEARING GREASE OR EQUAL
- POSTS SHALL BE ENCASED WITH CONCRETE TO WITHIN 1 FT. OF GROUND LEVEL AND BACKFILL COMPACTED (3 POSTS)
- PRIOR TO GATE INSTALLATION, NOTIFY FOREST SERVICE FOR LOCATION ON ROAD
- PARTS MAY BE FLAME CUT AND ALL BURRS REMOVED
- INSTALL SIGNS AFTER INSTALLATION OF GATE
- TECHNICAL CONTACT IS JIM BUCKETT, FOREST SERVICE, WARREN, PA. (814) 728-6837

SIGN CODE



- (1) L-R AND (2) R-R TYPE 1 BARRICADE MARKERS - RED ON WHITE - 12" x 36"
 - (2) ROAD CLOSED TO PUBLIC MOTOR VEHICLE USE
 - (3) TYPE 2 OBJECT MARKERS (M-2-B) - YELLOW REFLECTORIZED - 6" x 12" (2) ON GATE POST AND (2) ON CLOSED POSITION LOCK POST (2) ON OPEN POSITION LOCK POST FACED TO ONCOMING TRAFFIC
- NOTE: ALL SIGNS SHALL BE FURNISHED BY THE FOREST SERVICE AND INSTALLED BY THE CONTRACTOR.

ESTIMATED QUANTITIES


MATERIAL	QUANTITY (LF)	REMARKS
1-1/2" DIA. PIPE (ND)	3' 4"	PIVOT TUBE
2" DIA. PIPE (ND)	39' 4"	CROSS ARM ASSEMBLY
6" DIA. PIPE (ND)	30' 0"	GATE POSTS (3)
3/8" x 1" STRAP	0' 10"	LOCK PIN
3/8" x 8" PLATE	4' 1"	MISC
ROLTS, NUTS, WASHERS	TWO (2) OF EACH	



DETAIL

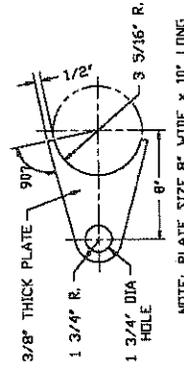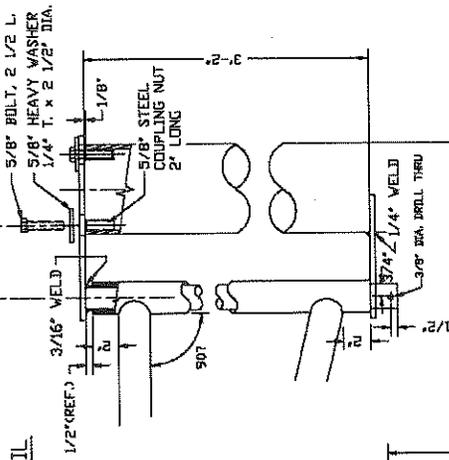

LEVEL 70' FOREST SERVICE GATE	
ALLEGHENY NATIONAL FOREST	
WARREN, PA	
DES. PAWNING, JOHNSON, RIBELLO-VEZIO	
DRAWN T. JOHNSON & R. GALLO - 12/89	
NOT TO SCALE	

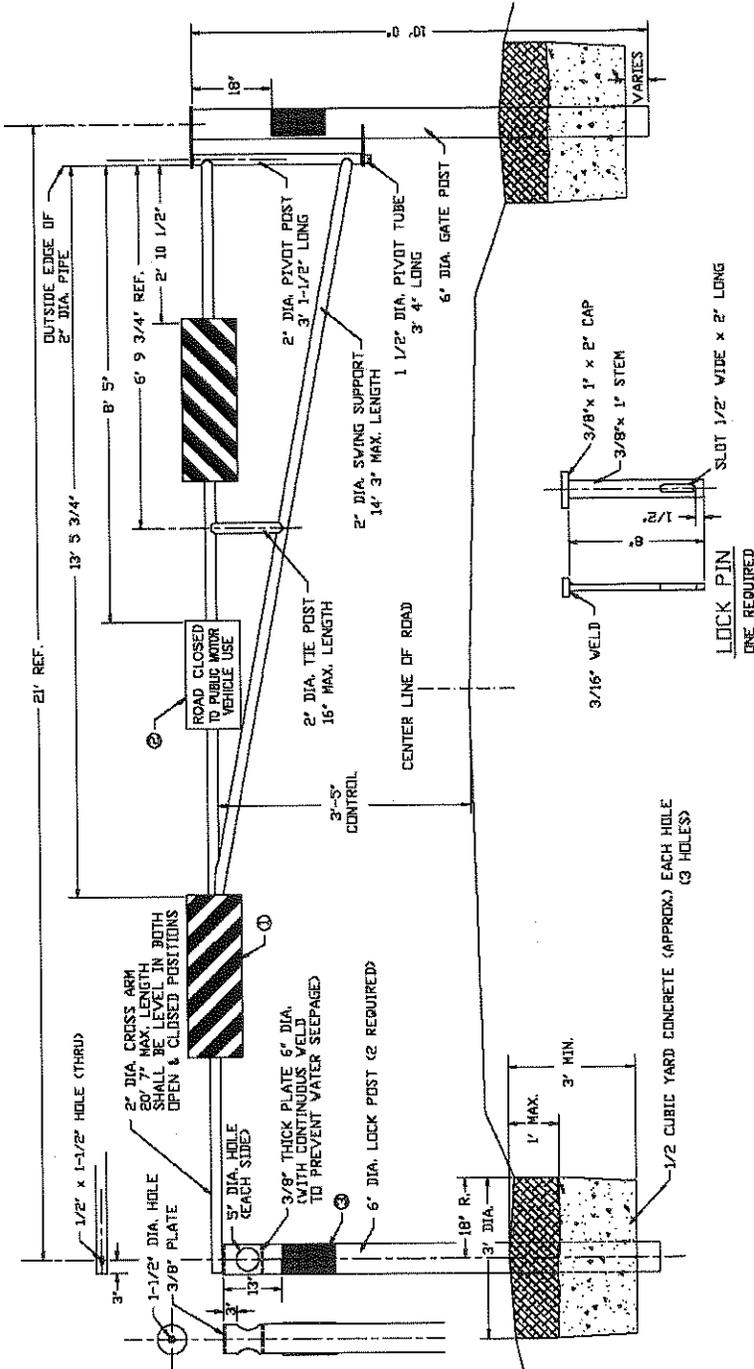

SCHEDULE OF ITEMS, SPECIFICATIONS & DRAWINGS FOR SPECIFIED ROADS

I. Road Summary	1 page
II. Schedule of Items	2 page
III. Specification List and Special Project Specifications	48 pages
IV. Road Plans: Hemlock Run Stewardship <u>Project No. 012</u>	10 pages

Contents

Road Summary.....	2
Schedule of Items.....	3
Specifications.....	5
Preface.....	5
101 - Terms, Format, and Definitions.....	6
102 - Bid, Award, and Execution of Contract	9
103 - Scope of Work.....	10
104 - Control of Work.....	11
105 - Control of Material	12
106 - Acceptance of Work	13
107 - Legal Relations and Responsibility to the Public.....	14
108 - Prosecution and Progress.....	16
109 - Measurement and Payment.....	17
151 - Mobilization.....	18
155 - Schedules for Construction Contracts	19
203 - Removal of Structures and Obstructions.....	20
204 - Excavation and Embankment.....	21
230 - Roadside Brushing.....	34
SPS 25308 – French Mattresses – Special Project Specification	36
301 - Untreated Aggregate Courses.....	39
303 - Reconditioning.....	43
602 - Culverts and Drains	46
625 - Turf Establishment	47
SPS 703 - Aggregate.....	50
SPS 705 - Rock.....	52

Road Summary

SPECIFIED ROADS

a. Description of Work:

Water and Soil Rehabilitation: Bean Fields Wildlife Corridors (Main and Old Irvine Estate Grounds Corridors)

Corridor Reconditioning, Mobilization, 1" minus Surfacing, Culvert Installation, Seeding & Mulching, Clearing and Grubbing, Corridor Ditching, Removal of Culverts, French Mattress Construction and Brushing

b. Rehabilitation Costs:

<u>Corridor Name/Description</u>	<u>Miles</u>	<u>Estimated Cost</u>
Bean Fields Wildlife Main Corridor	1.1	\$
Bean Fields Wildlife Old Irvine Estate Grounds Corridor	0.8	\$
TOTAL		\$

Completion dates: 9/30/2015

Schedule of Items

Bean Fields Wildlife Main Corridor

Pay Item	Description	Pay Unit	Estimated Quantity	Engineer's Estimate Unit Price	Engineer's Extended Total
15101	Mobilization (Lump Sum)	All	1		
20301	Removal of culverts	Each	5		
20412	Ditch line excavation and waste excavation disposal	Linear Foot	1576		
20701	Earthwork geotextile Type II nonwoven for separation	Square Yard	903		
23050	Brushing (spot brushing)	Mile	0.5		
25102	Placed riprap, class R-4	Ton	3		
30101	Aggregate base , grading PA-2A, compaction method B	Ton	182		
30115	Aggregate surface course , Type 1" minus, compaction method B	Ton	692		
30326	Corridor reconditioning (dozer)	Mile	1.2		
60201	16" steel pipe casing	Foot	124		
60201	22" steel pipe casing	Foot	168		
60263	36 inch aluminized steel, type 2, corrugated steel pipe, 0.079 inch thickness, method A	Linear Foot	20		
62501	Seeding, hydraulic or dry method (Lump Sum)	All	1		
65003	Gate Repair	Each	2		
TOTAL					

Bean Fields Wildlife Old Irvine Estate Grounds Corridor

Pay Item	Description	Pay Unit	Estimated Quantity	Engineer's Estimate Unit Price	Engineer's Extended Total
15101	Mobilization (Lump Sum)	All	1		
20405	Excavation and waste excavation disposal	Cubic Yard	8		
20701	Earthwork geotextile type nonwoven	Square Yard	35		
23050	Brushing (spot brushing)	Mile	0.3		
25102	Placed riprap, class R-4	Ton	14		
30101	Aggregate base , grading #3 rock, compaction method B	Ton	5		
30115	Aggregate surface course , Type 1" minus, compaction method B	Ton	81		
62501	Seeding, hydraulic or dry method (Lump Sum)	All	1		
TOTAL					

Specifications

The following specifications will be used for this contract:

Standard Specifications for Construction of Roads and Bridges on Federal Highway Projects – FP-03 U.S. Customary Units. FP-03 is available on the internet at the following site: <http://flh.fhwa.dot.gov/resources/pse/specs/>

Supplemental Specifications – These specifications were prepared by the Forest Service and are a supplement to or change the FHWA specifications.

Special Project Specifications – Are specifications prepared on the Allegheny National Forest and pertain to Pennsylvania Department of Transportation nomenclature. These are designated SPS.

Preface

Preface_wo_03_15_2004_m

Delete all but the first paragraph and add the following:

The Forest Service, US Department of Agriculture has adopted FP-03 for construction of National Forest System Roads.

101 - Terms, Format, and Definitions

101.00_nat_us_07_25_2005

101.01_nat_us_01_22_2009

101.01 Meaning of Terms

Delete all references to the TAR (Transportation Acquisition Regulations) in the specifications.

101.03_nat_us_06_16_2006

101.03 Abbreviations.

Add the following to (a) Acronyms:

AFPA	American Forest and Paper Association
MSHA	Mine Safety and Health Administration
NIST	<u>National Institute of Standards and Technology</u>
NESC	National Electrical Safety Code
WCLIB	West Coast Lumber Inspection Bureau

Add the following to (b) SI symbols:

mp	Milepost
ppm	Part Per Million

101.04_nat_us_03_29_2007

101.04 Definitions.

Delete the following definitions and substitute the following:

Bid Schedule--The Schedule of Items.

Bridge--No definition.

Contractor--The individual or legal entity contracting with the Government for performance of prescribed work. In a timber sale contract, the contractor is the "purchaser".

Culvert--No definition.

Right-of-Way--A general term denoting (1) the privilege to pass over land in some particular line (including easement, lease, permit, or license to occupy, use, or traverse public or private lands), or (2) Real property necessary for the project, including roadway, buffer areas, access, and drainage areas.

Add the following:

Adjustment in Contract Price--“Equitable adjustment,” as used in the Federal Acquisition Regulations, or “construction cost adjustment,” as used in the Timber Sale Contract, as applicable.

Change--“Change” means “change order” as used in the Federal Acquisition Regulations, or “design change” as used in the Timber Sale Contract.

Design Quantity--“Design quantity” is a Forest Service method of measurement from the FS-96 *Forest Service Specifications for the Construction of Roads and Bridges*. Under these FP specifications this term is replaced by the term “Contract Quantities”.

Forest Service--The United States of America, acting through the Forest Service, U.S. Department of Agriculture.

Neat Line--A line defining the proposed or specified limits of an excavation or structure.

Pioneer Road--Temporary construction access built along the route of the project.

Purchaser--The individual, partnership, joint venture, or corporation contracting with the Government under the terms of a Timber Sale Contract and acting independently or through agents, employees, or subcontractors.

Protected Streamcourse--A drainage shown on the plans or timber sale area map that requires designated mitigation measures.


Road Order--An order affecting and controlling traffic on roads under Forest Service jurisdiction. Road Orders are issued by a designated Forest Officer under the authorities of 36 CFR, part 260.

Schedule of Items--A schedule in the contract that contains a listing and description of construction items, quantities, units of measure, unit price, and amount.

Utilization Standards--The minimum size and percent soundness of trees described in the specifications to determine merchantable timber.

Add Figure 101-1—Illustration of road structure terms:

Figure 101-1—Illustration of road structure terms.

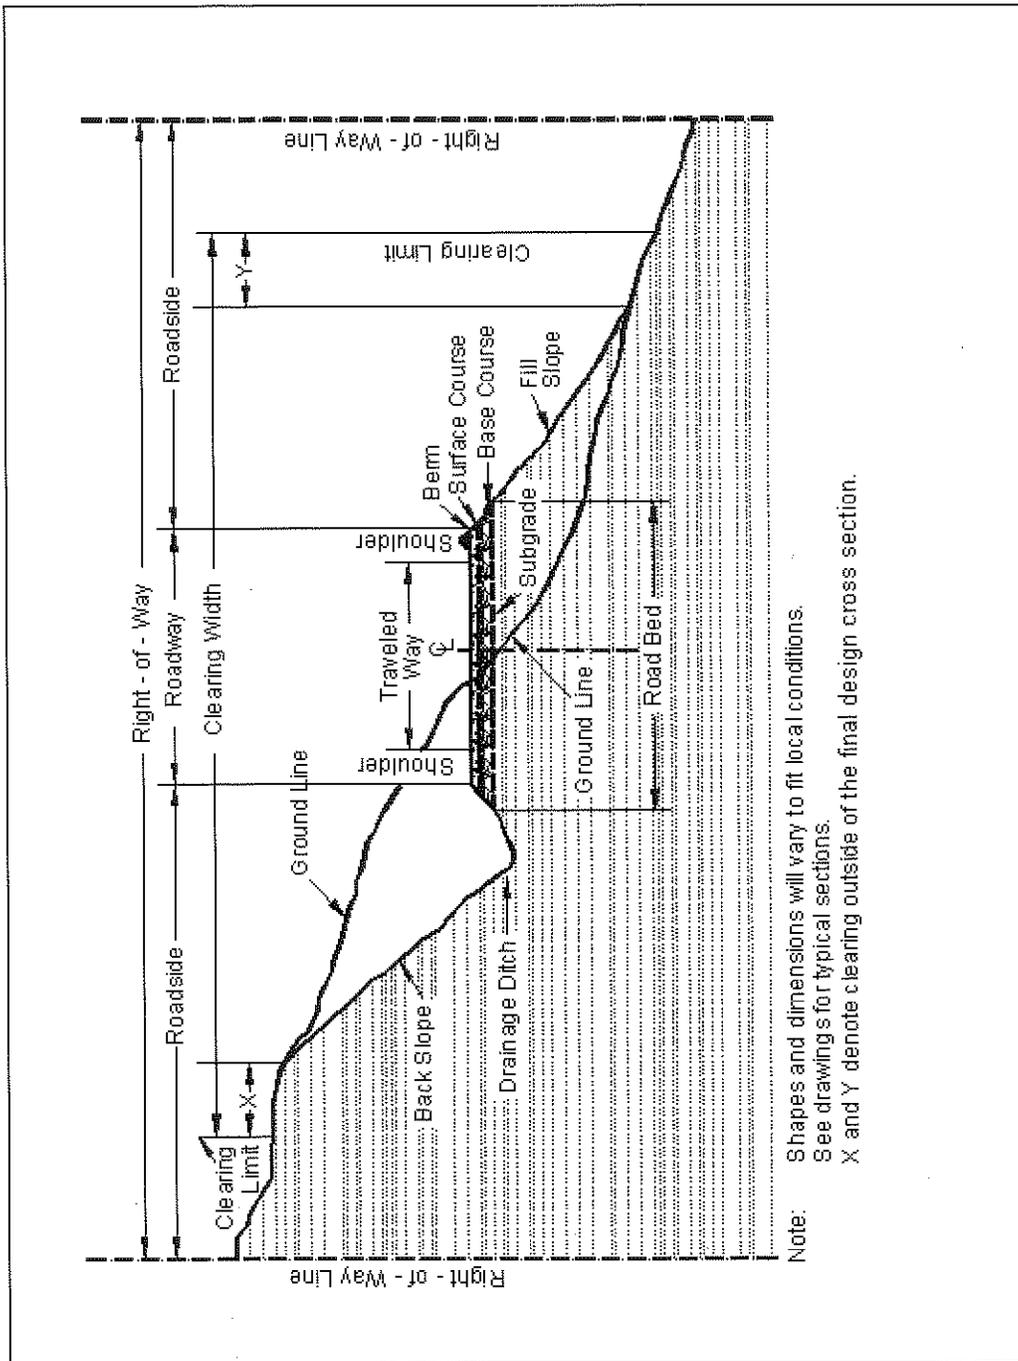

102 - Bid, Award, and Execution of Contract

102.00_nat_us_02_16_2005

102 Bid, Award, and Execution of Contract

Delete Section 102 in its entirety.

103 - Scope of Work

103.00_nat_us_02_16_2005

Deletions

Delete all but subsection 103.01 Intent of Contract.

104 - Control of Work

104.00_nat_us_06_16_2006

Deletions

Delete Sections 104.01, 104.02, and 104.04.

104.06_nat_us_02_17_2005

Add the following subsection:

104.06 Use of Roads by Contractor

The Contractor is authorized to use roads under the jurisdiction of the Forest Service for all activities necessary to complete this contract, subject to the limitations and authorizations designated in the Road Order(s) or described in the contract, when such use will not damage the roads or national forest resources, and when traffic can be accommodated safely.

105 - Control of Material

105.02_nat_us_01_18_2007

105.02 Material Sources.

105.02(a) Government-provided sources.

Add the following:

Comply with the requirements of 30 CFR 56, subparts B and H. Use all suitable material for aggregate regardless of size unless otherwise designated. When required, re-establish vegetation in disturbed areas according to section 625.

105.05_nat_us_05_12_2004

105.05 Use of Material Found in the Work.

Delete 105.05 (a) and (b) and the last sentence of the second paragraph and substitute the following:

Materials produced or processed from Government lands in excess of the quantities required for performance of this contract are the property of the Government. The Government is not obligated to make reimbursement for the cost of producing these materials.

106 - Acceptance of Work

106.07_nat_us_05_11_2004

106.07 Delete

Delete subsection 106.07.

107 - Legal Relations and Responsibility to the Public

107.05_nat_us_05_11_2004

107.05 Responsibility for Damage Claims.

Delete the entire subsection.

107.06_nat_us_06_16_2006

107.06 Contractor's Responsibility for Work.

Delete the following from the first paragraph.

“except as provided in Subsection 106.07”.

107.09_nat_us_06_16_2006

107.09 Legal Relationship of the Parties.

Delete the entire subsection.

107.10_nat_us_06_16_2006

107.10 Environmental Protection.

Add the following:

Design and locate equipment repair shops, stationary refueling sites, or other facilities to minimize the potential and impacts of hazardous material spills on Government land.

Before beginning any work, submit a Hazardous Spill Plan. List actions to be taken in the event of a spill. Incorporate preventive measures to be taken, such as the location of mobile refueling facilities, storage and handling of hazardous materials, and similar information. Immediately notify the CO of all hazardous material spills. Provide a written narrative report form no later than 24 hours after the initial report and include the following:

- Description of the item spilled (including identity, quantity, manifest number, and other identifying information).
- Whether amount spilled is EPA or state reportable, and if so whether it was reported, and to whom.
- Exact time and location of spill including a description of the area involved.
- Containment procedures.
- Summary of any communications the Contractor had with news media, Federal, state and local regulatory agencies and officials, or Forest Service officials.
- Description of clean-up procedures employed or to be employed at the site including final disposition and disposal location of spill residue.

When available provide copies of all spill related clean up and closure documentation and correspondence from regulatory agencies.

The Contractor is solely responsible for all spills or leaks that occur during the performance of this contract. Clean up spills or leaks to the satisfaction of the CO and in a manner that complies with Federal, state, and local laws and regulations.

108 - Prosecution and Progress

108.00_nat_us_02_16_2005

108 Delete.

Delete Section 108 in its entirety.

109 - Measurement and Payment

109.00_nat_us_02_17_2005

109 Deletions

Delete the following entire subsections:

109.06 Pricing of Adjustments.

109.07 Eliminated Work.

109.08 Progress Payments.

109.09 Final Payment.

109.02_nat_us_06_16_2006

109.02 Measurement Terms and Definitions.

(b) Contract quantity.

Add the following:

Contract quantities will be adjusted only when there are errors in the original design of 15% or more.

Change the following:

“(b) Cubic yard” to “(c) Cubic yard”.

Add the following definition:

(p) Thousand Board Feet (Mbf). 1,000 board feet based on nominal widths, thickness, and extreme usable length of each piece of lumber or timber actually incorporated in the job. For glued laminated timber, 1,000 board feet based on actual width, thickness, and length of each piece actually incorporated in the job.

151 - Mobilization

151.03_nat_us_08_05_2005

151.03 Payment

Delete the entire subsection and add the following:

151.03 Payment

Mobilization is considered an indirect cost of this contract and will not be compensated as a separate work item.

155 - Schedules for Construction Contracts

155.00_nat_us_05_11_2004

155 Delete.

Delete Section 155 in its entirety.

203 - Removal of Structures and Obstructions

203.01_nat_us_02_25_2005

203.01 Description.

Delete and replace with the following:

This work consists of disposing of construction slash and debris, salvaging, removing, and disposing of buildings, fences, structures, pavements, culverts, utilities, curbs, sidewalks, and other obstructions.

203.05_nat_us_02_24_2005

203.05 Disposing of Material.

Add the following:

(e): Scattering. Scatter pieces of wood less than 3 inches in diameter and 3 feet in length within the clearing limits. Do not place construction slash in lakes, meadows, streams, or streambeds. Immediately remove construction slash that interferes with drainage structures.

203.08_nat_us_02_24_2005

203.08 Payment

Add the following:

Disposal of construction slash will be compensated under the designated pay item in Section 201.

204 - Excavation and Embankment

204.00_nat_us_03_26_2009

Replace Section 204 in its entirety with the following:

Description

204.01 This work consists of excavating material and constructing embankments. This includes furnishing, hauling, stockpiling, placing, disposing, sloping, shaping, compacting, and finishing earthen and rocky material.

204.02 Definitions.

(a) **Excavation.** Excavation consists of the following:

(1) **Roadway excavation.** All material excavated from within the right-of-way or easement areas, except subexcavation covered in (2) below and structure excavation covered in Sections 208 and 209. Roadway excavation includes all material encountered regardless of its nature or characteristics.

(2) **Subexcavation.** Material excavated from below subgrade elevation in cut sections or from below the original groundline in embankment sections. Subexcavation does not include the work required by Subsections 204.05, 204.06(b), and 204.06(c).

(3) **Borrow excavation.** Material used for embankment construction that is obtained from outside the roadway prism. Borrow excavation includes unclassified borrow, select borrow, and select topping.

(b) **Embankment construction.** Embankment construction consists of placing and compacting roadway or borrow excavation. This work includes:

- (1) Preparing foundation for embankment;
- (2) Constructing roadway embankments;
- (3) Benching for side-hill embankments;
- (4) Constructing dikes, ramps, mounds, and berms; and
- (5) Backfilling subexcavated areas, holes, pits, and other depressions.

(c) **Conserved topsoil.** Excavated material conserved from the roadway excavation and embankment foundation areas that is suitable for growth of grass, cover crops, or native vegetation.

(d) **Waste.** Excess and unsuitable roadway excavation and subexcavation that cannot be used.

Material

204.03 Conform to the following Subsections:

Backfill material	704.03
Select borrow	704.07
Select topping	704.08
Topping	704.05
Unclassified borrow	704.06
Water	725.01

Construction Requirements

204.04 Preparation for Roadway Excavation and Embankment Construction. Clear the area of vegetation and obstructions according to Sections 201 and 203.

204.05 Reserved.

204.06 Roadway Excavation. Excavate as follows:

(a) General. Do not disturb material and vegetation outside the construction limits. Incorporate only suitable material into embankments. Replace any shortage of suitable material caused by premature disposal of roadway excavation. Dispose of unsuitable or excess excavation material according to Subsection 204.14.

At the end of each day's operations, shape to drain and compact the work area to a uniform cross-section. Eliminate all ruts and low spots that could hold water.

Retrieve material deposited outside of the clearing limits as directed by the CO. Place unsuitable material in designated areas.

(b) Rock cuts. Blast rock according to Section 205. Excavate rock cuts to 6 inches below subgrade within the roadbed limits. Backfill to subgrade with topping or with other suitable material. Compact the material according to Subsection 204.11

(c) Earth cuts. Scarify earth cuts to 6 inches below subgrade within the roadbed limits. Compact the scarified material according to Subsection 204.11.

(d) Pioneer Roads. Road pioneering, slash disposal, and grubbing of stumps may proceed concurrently with excavation. Conduct excavation and placement operations so material to be treated under Section 201 will not be incorporated into the roadway unless specified in the slash treatment method. Maintain drainage during pioneering operations.

Remove snow and ice in advance of the work and deposit beyond the roadway limits in a manner that will not waste material or generate sediment. Do not incorporate snow and ice into embankments. Place snow or ice in a manner to prevent resource damage.

204.07 Subexcavation. Excavate material to the limits designated by the CO. Take cross-sections according to Section 152. Prevent unsuitable material from becoming mixed with the backfill. Dispose of unsuitable material according to Subsection 204.14. Backfill the subexcavation with topping, or other suitable material. Compact the material according to Subsection 204.11.

204.08 Borrow Excavation. Use all suitable roadway excavation in embankment construction. Do not use borrow excavation when it results in excess roadway excavation. Deduct excess borrow excavation from the appropriate borrow excavation quantity.

Obtain borrow source acceptance according to Subsection 105.02. Develop and restore borrow sources according to Subsection 105.03. Do not excavate beyond the established limits. When applicable, shape the borrow source to permit accurate measurements when excavation is complete.

204.09 Preparing Foundation for Embankment Construction. Prepare foundation for embankment construction as follows:

(a) **Embankment less than 4 feet high over natural ground.** When designated, remove topsoil and break up the ground surface to a minimum depth of 6 inches by plowing or scarifying. Compact the ground surface according to Subsection 204.11.

(b) **Embankments over an existing asphalt, concrete, or gravel road surface.** Scarify gravel roads to a minimum depth of 6 inches. Scarify or pulverize asphalt and concrete roads to 6 inches below the pavement. Reduce all particles to a maximum size of 6 inches and produce a uniform material. Compact the surface according to Subsection 204.11.

(c) **Embankment across ground not capable of supporting equipment.** Dump successive loads of embankment material in a uniformly distributed layer to construct the lower portion of the embankment. Limit the layer thickness to the minimum depth necessary to support the equipment.

(d) **Embankment on an existing slope steeper than 1V:3H.** Cut horizontal benches in the existing slope to a sufficient width to accommodate placement and compaction operations and equipment. Bench the slope as the embankment is placed and compacted in layers. Begin each bench at the intersection of the original ground and the vertical cut of the previous bench.

204.10 Embankment Construction. Incorporate only suitable roadway excavation material into the embankment. When the supply of suitable roadway excavation is exhausted, furnish unclassified borrow to complete the embankment. Obtain written approval before beginning construction of embankments over 6 feet high at subgrade centerline. Construct embankments as follows:

(a) General. At the end of each day's operations, shape to drain and compact the embankment surface to a uniform cross-section. Eliminate all ruts and low spots that could hold water.

During all stages of construction, route and distribute hauling and leveling equipment over the width and length of each layer of material.

Compact embankment side slopes flatter than 1V:1.75H with a tamping type roller or by walking with a dozer. For slopes 1V:1.75H or steeper, compact the slopes as construction of the embankment progresses.

Where placing embankment on one side of abutments, wing walls, piers, or culvert headwalls, compact the material using methods that prevent excessive pressure against the structure.

Where placing embankment material on both sides of a concrete wall or box structure, conduct operations so compacted embankment material is at the same elevation on both sides of the structure.

Where structural pilings are placed in embankment locations, limit the maximum particle size to 4 inches.

(b) Embankment within the roadway prism. Place embankment material in horizontal layers not exceeding 12 inches in compacted thickness. Incorporate oversize boulders or rock fragments into the 12-inch layers by reducing them in size or placing them individually as required by (c) below. Compact each layer according to Subsection 204.11 before placing the next layer.

Material composed predominately of boulders or rock fragments too large for 12-inch layers may be placed in layers up to 24 inches thick. Incorporate oversize boulders or rock fragments into the 24-inch layer by reducing them in size or placing them individually according to (c) below. Place sufficient earth and smaller rocks to fill the voids. Compact each layer according to Subsection 204.11 before placing the next layer.

(c) Individual rock fragments and boulders. Place individual rock fragments and boulders greater than 24 inches in diameter as follows:

- (1) Reduce rock to less than 48 inches in the largest dimension.
- (2) Distribute rock within the embankment to prevent nesting.
- (3) Place layers of embankment material around each rock to a depth not greater than that permitted by (b) above. Fill all the voids between rocks.
- (4) Compact each layer according to Subsection 204.11 before placing the next layer.

(d) Embankment outside of roadway prism. Where placing embankment outside the staked roadway prism, place material in horizontal layers not exceeding 24 inches in compacted thickness. Compact each layer according to Subsection 204.11.

204.11 Compaction. Compact the embankment using one of the following methods as specified:

(a) Compaction A. Use AASHTO T 27 to determine the amount of material retained on a Number 4 sieve. If there is more than 80 percent retained on the No. 4 sieve use procedure (1). If there is 50 to 80 percent retained on the No. 4 sieve use procedure (2). If there is less than 50 percent retained on the No. 4 sieve use procedure (3).

(1) Adjust the moisture content to a level suitable for compaction. Fill the interstices around rock with earth or other fine material as practical. Use compression-type rollers at speeds less than 6 feet per second and vibratory rollers at speeds less than 3 feet per second. Compact each layer of material full width with one of the following and until there is no visible evidence of further consolidation.

(a) Four roller passes of a vibratory roller having a minimum dynamic force of 40,000 pounds impact per vibration and a minimum frequency of 1000 vibrations per minute.

(b) Eight roller passes of a 20-ton compression-type roller.

(c) Eight roller passes of a vibratory roller having a minimum dynamic force of 30,000 pounds impact per vibration and a minimum frequency of 1000 vibrations per minute.

Increase the compactive effort for layers deeper than 12 inches as follows:

- For each additional 6 inches or fraction thereof, increase the number of roller passes in (a) above by four passes.
- For each additional 6 inches or fraction thereof, increase the number of roller passes in (b) and (c) above, by eight passes.

(2) Use AASHTO T 99 to determine the optimum moisture content of the portion of the material passing a No. 4 sieve. Multiply this number by the percentage of material passing a No. 4 sieve, and add 2 percent to determine the optimum moisture content of the material. Adjust the moisture content of material classified A-1 through A-5 to a moisture content suitable for compaction. Adjust the moisture content of material classified A-6 and A-7 to within 2 percent of the optimum moisture content.

Use compression-type rollers at speeds less than 6 feet per second and vibratory rollers at speeds less than 3 feet per second. Compact each layer of material full width according to (1) above.

(3) Classify the material according to AASHTO M 145. For material classified A-1 or A-2-4, determine the maximum density according to AASHTO T 180, method

D. For other material classifications, determine the optimum moisture content and maximum density according to AASHTO T 99, method C.

Adjust the moisture content of material classified A-1 through A-5 to a moisture content suitable for compaction. Adjust the moisture content of material classified A-6 and A-7 to within 2 percent of the optimum moisture content.

Use compression-type or vibratory rollers. Compact each layer of material full width to at least 95 percent of the maximum density. Determine the in-place density and moisture content according to AASHTO T 310 or other approved test procedures. When required, use AASHTO T 224 to correct for coarse particles.

(b) Compaction B. Place material by end dumping to the minimum depth needed for operation of spreading equipment. Adjust the moisture content of the material to obtain a mass that will not visibly deflect under the load of the hauling and spreading equipment. Operate compaction equipment over the full width of each layer until there is no visible evidence of further consolidation or, if when a sheepsfoot roller is used, the roller “walks out” of the layer. Make at least three complete passes.

(c) Compaction C. Place material by end dumping to the minimum depth needed for operation of spreading equipment. Level and smooth each embankment layer before placing the next layers. Operate hauling and spreading equipment uniformly over the full width of each layer. Construct a solid embankment with adequate compaction by working smaller rock and fines in with the larger rocks to fill the voids, and by operating hauling and spreading equipment uniformly over the full width of each layer as the embankment is constructed.

204.12 Ditches. Slope, grade, and shape ditches. Remove all projecting roots, stumps, rock, or similar matter. Maintain all ditches in an open condition and free from leaves, sticks, and other debris.

Form furrow ditches by plowing or using other acceptable methods to produce a continuous furrow. Place all excavated material on the downhill side so the bottom of the ditch is approximately 18 inches below the crest of the loose material. Clean the ditch using a hand shovel, ditcher, or other suitable method. Shape to provide drainage without overflow.

204.13 Sloping, Shaping, and Finishing. Complete slopes, ditches, culverts, riprap, and other underground minor structures before placing aggregate courses. Slope, shape, and finish as follows:

(a) Sloping. Leave all earth slopes with uniform roughened surfaces, except as described in (b) below, with no noticeable break as viewed from the road. Except in solid rock, round tops and bottoms of all slopes including the slopes of drainage ditches. Round material overlaying solid rock to the extent practical. Scale all rock slopes. Slope rounding is not required on tolerance class D through M roads.

If a slide or slipout occurs on a cut or embankment slope, remove or replace the material, and repair or restore all damage to the work. Bench or key the slope to stabilize the slide. Reshape the cut or embankment slope to an acceptable condition.

(b) Stepped slopes. Where required by the contract, construct steps on slopes of $1\frac{1}{3}V:1H$ to $1V:2H$. Construct the steps approximately 18 inches high. Blend the steps into natural ground at the end of the cut. If the slope contains nonrippable rock outcrops, blend steps into the rock. Remove loose material found in transitional area. Except for removing large rocks that may fall, scaling stepped slopes is not required.

(c) Shaping. Shape the subgrade to a smooth surface and to the cross-section required. Shape slopes to gradually transition into slope adjustments without noticeable breaks. At the ends of cuts and at intersections of cuts and embankments, adjust slopes in the horizontal and vertical planes to blend into each other or into the natural ground.

(d) Finishing. Finish the roadbed to be smooth and uniform, and shaped to conform to the typical sections. Remove unsuitable material from the roadbed and replace it with suitable material. Finish roadbeds to the tolerance class shown in table 204-2. Ensure that the subgrade is visibly moist during shaping and dressing. Scarify to 6 inches below the bottom of low sections, holes, cracks, or depressions and bring back to grade with suitable material. Maintain proper ditch drainage.

For surfaced roads, remove all material larger than 6 inches from the top 6 inches of the roadbed.

For unsurfaced roads, use one of the following methods to finish the roadbed:

(1) Method A. Remove all material larger than 6 inches from the top 6 inches of the roadbed and replace with suitable material.

(2) Method B. Use a vibratory grid roller or approved equal with a minimum weight of 10 tons. Roll at least 5 full-width passes or until there is no visible evidence of further consolidation.

(3) Method C. For roads designated as Construction Tolerance Class K, L, or M, finish the roadbed by spreading the excavation. Eliminate rock berms.

204.14 Disposal of Unsuitable or Excess Material. Dispose of unsuitable or excess material at designated sites or legally off of the project.

When there is a pay item for waste, shape and compact the waste material in its final location. Do not mix clearing or other material not subject to payment with the waste material.

204.15 Acceptance. See Table 204-1 for sampling and testing requirements.

Material for embankment and conserved topsoil will be evaluated under Subsections 106.02 and 106.04.

Excavation and embankment construction will be evaluated under Subsections 106.02 and 106.04.

Clearing and removal of obstructions will be evaluated under Sections 201 and 203.

Measurement

204.16 Measure the Section 204 items listed in the bid schedule according to Subsection 109.02 and the following as applicable.

(a) Roadway excavation. Measure roadway excavation in its original position as follows:

(1) Include the following volumes in roadway excavation:

- (a)* Roadway prism excavation;
- (b)* Rock material excavated and removed from below subgrade in cut sections;
- (c)* Unsuitable material below subgrade and unsuitable material beneath embankment areas when a pay item for subexcavation is not shown in the bid schedule;
- (d)* Ditches, except furrow ditches measured under a separate bid item;
- (e)* Topsoil;
- (f)* Borrow material used in the work when a pay item for borrow is not shown in the bid schedule;
- (g)* Loose scattered rocks removed and placed as required within the roadway;
- (h)* Conserved material taken from stockpiles and used in Section 204 work; and
- (i)* Slide and slipout material not attributable to the Contractor's method of operation.

(2) Do not include the following in roadway excavation:

- (a)* Overburden and other spoil material from borrow sources;
- (b)* Overbreakage from the backslope in rock excavation;
- (c)* Water or other liquid material;
- (d)* Material used for purposes other than required;
- (e)* Roadbed material scarified in place and not removed;
- (f)* Material excavated when stepping cut slopes;
- (g)* Material excavated when rounding cut slopes;
- (h)* Preparing foundations for embankment construction;
- (i)* Material excavated when benching for embankments;
- (j)* Slide or slipout material attributable to the Contractor's method of operation;
- (k)* Conserved material taken from stockpiles constructed at the option of the

Contractor; and

(l) Material excavated outside the established slope limits.

(3) When both roadway excavation and embankment construction pay items are shown in the bid schedule, measure the following as roadway excavation only:

(a) Unsuitable material below subgrade in cuts and unsuitable material beneath embankment areas when a pay item for subexcavation is not shown in the bid schedule;

(b) Slide and slipout material not attributable to the Contractor's method of operations; and

(c) Drainage ditches, channel changes, and diversion ditches.

(b) Unclassified borrow, select borrow, and select topping. When measuring by the cubic yard measure in its original position. If borrow excavation is measured by the cubic yard in place, take initial cross-sections of the ground surface after stripping overburden. Upon completion of excavation and after the borrow source waste material is returned to the source, retake cross-sections before replacing the overburden. Do not measure borrow excavation used in place of excess roadway excavation.

(c) Embankment construction. Measure embankment construction in its final position. Do not make deductions from the embankment construction quantity for the volume of minor structures.

(1) Include the following volumes in embankment construction:

(a) Roadway embankments;

(b) Material used to backfill subexcavated areas, holes, pits, and other depressions;

(c) Material used to restore obliterated roadbeds to original contours; and

(d) Material used for dikes, ramps, mounds, and berms.

(2) Do not include the following in embankment construction:

(a) Preparing foundations for embankment construction;

(b) Adjustments for subsidence or settlement of the embankment or of the foundation on which the embankment is placed; and

(c) Material used to round fill slopes.

(d) Rounding cut slopes. Measure rounding cut slopes horizontally along the centerline of the roadway if a pay item for slope rounding is included in the bid schedule. If a pay item for slope rounding is not included in the bid schedule slope rounding will be considered subsidiary to excavation.

(e) Waste. Measure waste by the cubic yard in its final position. Take initial cross-sections of the ground surface after stripping overburden. Upon completion of the waste placement, retake cross-sections before replacing overburden.

(f) Slope scaling. Measure slope scaling by the cubic yard in the hauling vehicle.

Payment

204.17 The accepted quantities will be paid at the contract price per unit of measurement for the Section 204 pay items listed in the bid schedule. Payment will be full compensation for the work prescribed in this Section. See Subsection 109.05.

Table 204-1
Sampling and Testing Requirements

Material or Product	Type of Acceptance (Subsection)	Characteristic	Category	Test Methods Specifications	Sampling Frequency	Point of Sampling	Split Sample	Reporting Time
Topping (704.05) & unclassified borrow (704.06)	Measured and tested for conformance (106.04)	Classification	—	AASHTO M 145	1 per soil type	Processed material before incorporating in work	Yes, when requested	Before using in work
		Moisture-density	—	AASHTO T 180, method D ⁽¹⁾ or T 99, method C ⁽¹⁾	1 per soil type but not less than 1 per	"	"	"
		Compaction	—	AASHTO T 310 or other approved procedures	1 per 6000 yd ² but not less than 1 per layer	In-place	—	Before placing next layer
Select borrow (704.07) & Select topping (704.08)	Measured and tested for conformance (106.04)	Classification	—	AASHTO M 145	1 per soil type but not less than 1 for each day of production	Processed material before incorporating	Yes, when requested	Before using in work
		Gradation	—	AASHTO T 27	"	"	"	"
		Liquid limit	—	AASHTO T 89	"	"	"	"
		Moisture-density	—	AASHTO T 180, method D ⁽¹⁾ or T 99, method C ⁽¹⁾	1 per soil type but not less than 1 per	"	"	"
		Compaction	—	AASHTO T 310 or other approved procedures	1 per 6000 yd ² but not less than 1 per layer	In-place	—	Before placing next layer

(1) Minimum of 5 points per proctor

Table 204-1 (continued)
Sampling and Testing Requirements

Material or Product	Type of Acceptance (Subsection)	Characteristic	Category	Test Methods Specifications	Sampling Frequency	Point of Sampling	Split Sample	Reporting Time
Earth embankment (204.11, Compaction A)	Measured and tested for conformance (106.04)	Classification	—	AASHTO M 145	1 per soil type	Source of Material	Yes, when requested	Before using in work
		Moisture-density	—	AASHTO T 180, method D ⁽¹⁾ or T 99, method C ⁽¹⁾	1 per soil type but not less than 1 per 13,000 yd ³	“	“	“
		Compaction	—	AASHTO T 310 or other approved procedures	1 per 3500 yd ² but not less than 1 per layer	In-place	—	Before placing next layer
Top of subgrade (204.11 Compaction A)	Measured and tested for conformance (106.04)	Compaction	—	AASHTO T 310 or other approved procedures	1 per 2500 yd ²	In-place	—	Before placing next layer

(1) Minimum of 5 points per proctor.

Table 204-2
Construction Tolerances

	Tolerance Class ^(a)												
	A	B	C	D	E	F	G	H	I	J	K	L	M
Roadbed width (ft)	+0.5	+0.5	+1.0	+1.0	+1.0	+1.0	+1.5	+1.0	+2.0	+2.0	+2.0	+2.0	+2.0
Subgrade elevation (ft)	±0.1	±0.2	±0.2	±0.5	±0.5	±1.0	±1.0	±1.5	±2.0	±3.0	±2.0	±3.0	(c)
Centerline alignment (ft)	±0.2	±0.2	±0.5	±0.5	±1.0	±1.0	±1.5	±1.5	±2.0	±3.0	±3.0	±5.0	(c)
Slopes, excavation, and embankment (% slope) ^(b)	±3	±5	±5	±5	±5	±5	±10	±10	±10	±10	±20	±20	±20

(a) Maximum allowable deviation from construction stakes and drawings.

(b) Maximum allowable deviation from staked slope measured from slope stakes or hinge points.

(c) Unless otherwise shown the centerline alignment and subgrade elevation, as built, have no horizontal curves with a radius of less than 80 feet, and no vertical curves with a curve length of less than 80 feet when the algebraic difference in the grade change is less than 10 percent, or a curve length of less than 100 feet when the algebraic difference of the grade change is greater than or equal to 10 percent. The centerline grade is not to exceed 20 percent in 100 feet of length.

230 - Roadside Brushing

230.00_0114_us_08_04_2005

Description

230.01 Work. This work consists of removing all vegetative material including limbs, residual slash, live roadside brush, and small trees within the brushing limits designated on the plans.

Construction

230.02 Brushing. Cut all brush and small trees (6 inches diameter, or less, at the point of cut) inside the brushing limits and outside the roadbed no higher than 4 inches above ground level (6 inches for machine brushing). If rocks or other obstructions are encountered, cut no higher than 6 inches above the obstruction. Limb live trees with a diameter larger than 6 inches to provide a clear height of 14 feet above the road surface.

Cut all brush and trees located on the roadbed as nearly flush to the road surface as possible so stumps will not become a hazard to vehicle tires.

230.03 Windfalls. Limb windfalls lying within or across the brushing limits, cut off at the top of the existing cut slope or 5 feet from the shoulder on the fill slope. Dispose of windfall material as slash.

230.04 Road Junctions. Do not deposit brushing debris on the roadway of adjoining roads.

230.05 Slash Treatment. Scatter slash outside the brushing limits without damaging residual trees. Slash is defined as any material that has a length greater than 36 inches or a diameter greater than 2 inches at any point. Do not deposit material in streams, streambeds, culvert inlets or outlets, drainage ways, or cattle guards.

230.06 Acceptance. Roadside brushing will be evaluated under Subsection 106.02.

Measurement

230.07 Method. Measure the Section 230 items listed in the bid schedule according to Subsection 109.02 and the following.

Linear measurements will be horizontal along the road centerline.

Quantities will be the number of miles (or stations) and fractions thereof along the road centerline.

Payment

230.08. The accepted quantities will be paid at the contract price per unit of measurement for the section 230 pay items listed in the bid schedule. Payment will be full compensation for the work prescribed in this section. See Subsection 109.05.

SPS 25308 – French Mattresses – Special Project Specification

25308.01 Description

This work consists of constructing French mattresses. A structure under a road/corridor consisting of clean coarse rock wrapped in fabric through which water can freely pass.

25308.02 Material

Geotextile type II for separation
Riprap rock R-4
ASSHTO Rock # 3 (clean rock)
1" minus surfacing

25308.03 Construction Requirements

Excavate the section of the corridor where the mattress will be located to desired depth. Lay geotextile separation fabric in the bottom of the area after excavation and leveling. Leave enough fabric on the ends to wrap around and overlap with top fabric later.

Place 12" of riprap R-4 on top of the fabric and spread out into a uniform bed.

Place 4" layer of ASSHTO #3 on top of the riprap. Do not intermix the two stone sizes. The empty spaces between the large stone, and therefore flow capacity, will be reduced if the small stone is intermixed. Spread increasingly smaller stone on top to create layer that will not puncture fabric.

Wrap ends of lower fabric up on top of structure. Place a piece of fabric on the top if existing fabric does not completely cover mattress. All fabric "joints" should overlap by at least 18".

Place 4" of surface aggregate, 1" minus, over the structure.


25308.04 Payment

Payment for this work will be paid under sections 20405, 20701, 25102, 30101 and 30115 listed in the schedule of items.

French Mattress: A structure under a road consisting of clean coarse rock wrapped in geotextile fabric through which water can pass freely. French mattresses are used in extremely wet areas, such as wetlands, to support the roadbed while allowing unrestricted water movement.

Criteria for French Mattress Use

- Areas where concentrated outlet flow through a pipe is undesirable, impractical, or regulated.
- Low-lying areas near streams or wetlands where installing cross drains would be difficult due to lack of grade or vegetation.
- Areas where the road acts as a dam by cutting off the natural flow of subsurface water.
- Areas with a high water table.

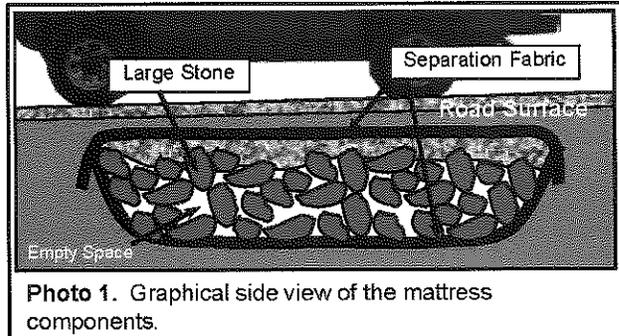

Benefits of French mattresses

- Stabilizes the road base in areas where the road is weakened by water saturation.
- Allows for bi-directional free flow of water through road base.
- Maintains dispersed flows and prevents gully erosion above or below the structure.
- Can be used in wetland situations where a traditional pipe may lower the wetland water level.
- Requires no maintenance and has a long service life.
- Unlike pipes, French Mattresses are extremely difficult for beavers to plug.
- Maintains natural vegetative communities and habitat by connecting floodplains.

Important mattress considerations

- Mattresses are **NOT** stream or road drainage pipe replacements. Mattresses should **NOT** be used for concentrated overland flow, such as small stream channels or storm water from ditches. These flows naturally carry sediment, which will clog the mattress over time.
- Mattress size is very flexible. In the example below, three small mattresses were used to drain several springs and seeps. In the example on the back, a large mattress was used to allow wetland flow through during high flows. The width, depth, and size of stone used will all affect the flow capacity of the mattress.
- The finished mattress should be covered by at least 8 inches of compacted fill material.
- French mattresses should be installed to match the slope of the land. In wetland situations, this slope may be minimal. In sloped areas (as pictured below), a 1- to 2-percent slope should be used to aid drainage.



Photo 2. Small mattresses installed to drain several springs and seep.

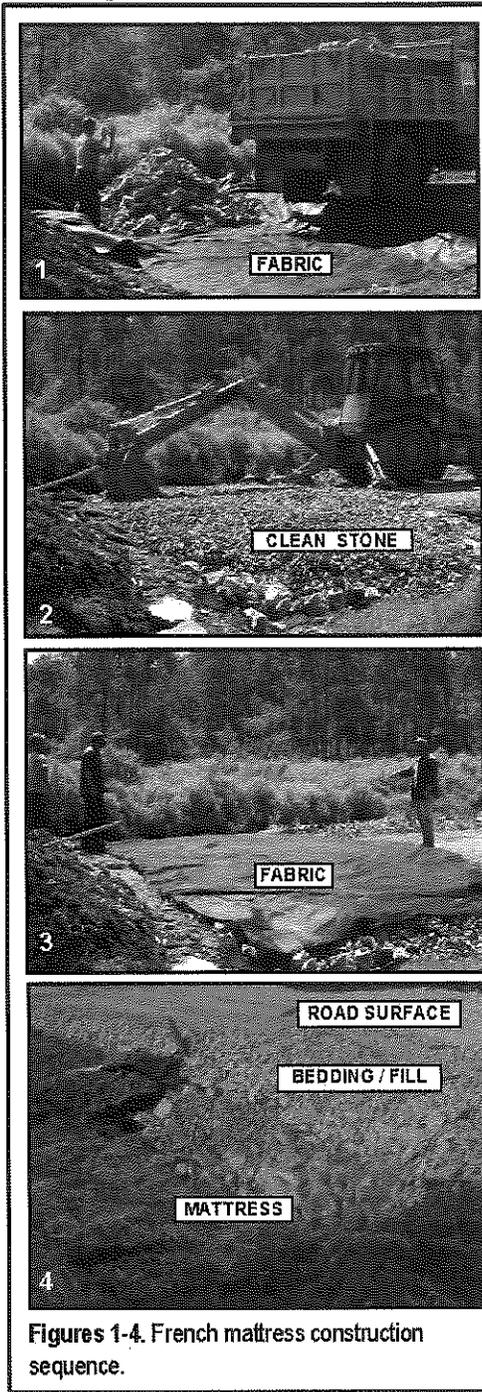


Photo 3. Large mattresses allow wetland flow.

The publishers of this publication gratefully acknowledge the financial support of the PA State Conservation Commission. For additional information or assistance, contact: Center for Dirt & Gravel Roads Studies, Penn State University, 215 Transportation Research Building, University Park, PA 16802 (Toll-Free Phone: 1-866-668-6683, Fax: 814-863-8787, Email: dirtandgravel@psu.edu). Additional copies available on our website at www.dirtandgravelroads.org.



© 2013 All Rights Reserved



Figures 1-4. French mattress construction sequence.

Reminder: A French mattress should never be used to replace a standard stream pipe or road drainage crosspipe. The frequent flows and sediment load from these sources will eventually clog the mattress.

Construction Sequence

This is a large mattress using large stone to accommodate a wide wetland.

1. Excavate the mattress to desired depth, allowing for a minimum 8 inches of cover over the mattress. Place geotextile fabric in the trench, leaving enough fabric on the sides to overlap on the top of the finished mattress (Figure 1).
2. Place porous stone on top of the fabric and spread out into a uniform bed (Figure 2).
3. Wrap ends of fabric over top of structure. Place a piece of fabric on the top if existing fabric does not completely cover mattress. Overlap all fabric joints by at least 12 inches (Figure 3).
4. Compact fill over top of finished mattress (Figure 4).

Materials required for a French mattress:

- **Geotextile fabric (Class 2 woven):** The fabric around the mattress allows water to pass through while blocking fine silt and clay, which would eventually clog the structure. In situations where water flowing into the mattress may contain sediment (farm fields, etc.), the ends of the mattress should also be wrapped in fabric.
- **Clean Stone:** Use clean stone. Clean stone is relatively uniform in size with no fine material. Typically 3- to 4-inch-diameter stone is used. Larger stones will increase the flow capacity of the mattress.

Equipment required for a French mattress

- **Excavator/backhoe:** Needed to excavate trench; helps to spread stone after dumping.
- **Trucks:** Needed to import clean stone (rock) and haul away excavated material.
- **Hand Tools:** Rakes and shovels to move and level stone.
- **Compaction:** A tamper or vibratory plate can compact fill over small mattresses. A roller is needed for larger mattresses.

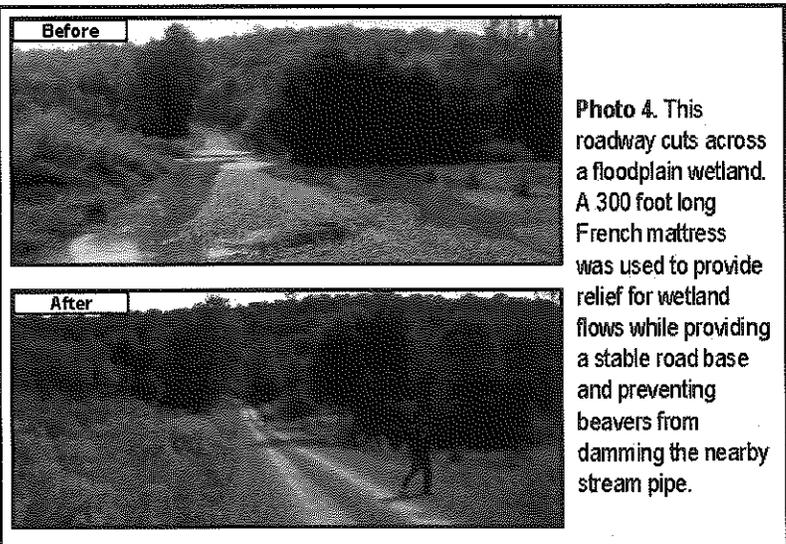


Photo 4. This roadway cuts across a floodplain wetland. A 300 foot long French mattress was used to provide relief for wetland flows while providing a stable road base and preventing beavers from damming the nearby stream pipe.

301 - Untreated Aggregate Courses

301.00_nat_us_03_03_2005

301 Title Change.

Change the title to: Section 301 Aggregate Courses

301.01_nat_us_03_03_2005

301.01 Work.

Add the following:

Work includes producing aggregate by pit-run, grid rolling, screening, or crushing methods, or placing Government-furnished aggregate. Work may include additive mineral filler, or binder.

301.02_nat_us_05_16_2005

301.02 Material.

Add the following:

Bentonite	725.30
Calcium Chloride Flake	725.02
Lignon Sulfonate	725.20
Magnesium Chloride Brine or Calcium Chloride Liquid	725.02

301.03_nat_us_09_14_2005

301.03 General.

Add the following:

Written approval of the roadbed is required before placing aggregate.

For pit run or grid-rolled material, furnish material smaller than the maximum size. No gradation other than maximum size will be required for pit-run or grid-rolled material. For grid rolling, use all suitable material that can be reduced to maximum size. After processing on the road, remove all oversize material from the road and dispose of it as directed by the CO.

Provide additives or binder, if required, at the proportions specified.

Develop and use Government furnished sources according to Section 105.

If the aggregate is produced and stockpiled before placement, handle and stockpiled according to Section 320. Establish stockpile sites at locations approved. Clear and grub stockpile sites according to Section 201.

301.04_nat_us_03_03_2005

301.04 Mixing and Spreading.

Delete the first sentence of the first paragraph and add the following:

Ensure that aggregate and any required additives, water, mineral filler, and binder are mixed by the specified method except, if crushed aggregate products are being produced and mineral filler, binder, or additives are required, uniformly blend following crushing. Control additive proportions to 0.5 percent dry weight.

(a) Stationary Plant Method. Mix the aggregate with other required materials in an approved mixer. Add water during the mixing operation in the amount necessary to provide the moisture content for compacting to the specified density. After mixing, transport the aggregate to the jobsite while it contains the proper moisture content, and place it on the roadbed or base course using an aggregate spreader.

(b) Travel Plant Method. After placing the aggregate for each layer with an aggregate spreader or windrow-sizing device, uniformly mix it with other required materials using a traveling mixing plant. During mixing, add water to provide the necessary moisture content for compacting.

(c) Road Mix Method. After placing the aggregate for each layer, mix it with other required materials at the required moisture content until the mixture is uniform throughout. Mix aggregate, water, and all other materials until a uniform distribution is obtained.

Spread the aggregate in a uniform layer, with no segregation of size, and to a loose depth that will provide the required compacted thickness.

When placing aggregate over geotextile, place aggregate in a single lift to the full depth specified.

Route and distribute hauling and leveling equipment over the width and length of each layer.

301.05_nat_us_05_17_2005

301.05 Compacting

Delete and replace with the following:

Compact each layer full width. Roll from the sides to the center, parallel to the centerline of the road. Along curbs, headers, walls, and all places not accessible to the roller, compact the material with approved tampers or compactors.

Compact the aggregate using one of the following methods as specified:

Compaction A. Operating spreading and hauling equipment over the full width of the travelway.

Compaction B. Operate rollers and compact as specified in Subsection 204.11(a)(1).

Compaction C. Moisten or dry the aggregate to a uniform moisture content between 5 and 7 percent based on total dry weight of the mixture. Operate rollers and compact as specified in Subsection 204.11(a)(1).

Compaction D. Compact to a density of at least 95 percent of the maximum density, as determined by AASHTO T 99, method C or D.

Compaction E. Compact to a density of at least 96 percent of the maximum density, as determined by the Modified Marshall Hammer Compaction Method (available upon request from USDA Forest Service, Regional Materials Engineering Center, P.O. Box 7669, Missoula, MT 59807).

Compaction F. Compact to a density of at least 95 per-cent of the maximum density, as determined by AASHTO T 180, method C or D.

Compaction G. Compact to a density of at least 100 percent of the maximum density as determined by the Modified Marshall Hammer Compaction Method (available upon request from USDA Forest Service, Regional Materials Engineering Center, P.O. Box 7669, Missoula, MT 59807).

For all compaction methods, blade the surface of each layer during the compaction operations to remove irregularities and produce a smooth, even surface. When a density requirement is specified, determine the in place density and moisture content according to AASHTO T 310 or other approved test procedures.

301.06_nat_us_03_03_2005

301.06 Surface Tolerance.

Add the following:

Thickness and Width requirements:

The maximum variation from the compacted specified thickness is ½ inch. The compacted thickness is not consistently above or below the specified thickness and the average thickness of 4 random measurements for any ½ mile of road segment is within + ¼ inch of the specified thickness.

The maximum variation from the specified width will not exceed +12 inches at any point. The compacted width is not consistently above the specified width and the average of any four random measurements along any ½ mile of road segment is within +4 inches of the specified width.

301.09_nat_us_07_07_2005

301.09 Measurement.

Replace the second paragraph with the following:

Measure aggregate by cubic yard compacted in place when payment is by contract quantities.

301.10_nat_us_03_03_2005

301.10 Payment

Delete the following:

adjusted according to Subsection 106.05

303 - Reconditioning

303.00_01_us_10_11_2006

Delete Section 303 in its entirety and replace with the following.

Description

303.01 This work consists of reconditioning ditches, shoulders, roadbeds, parking areas, turnouts, approach road intersections, cattleguards, asphalt surfaces and aggregate surfaces. Construct outlopes, clean and maintain all roadbed drainage structures when shown on the plans.

Material

303.02 Conform to the following Subsection:

Water 725.01

Construction Requirements

303.03 Ditch Reconditioning. Remove all slide material, sediment, vegetation, and other debris from the existing ditches and culvert inlets and outlets. Reshape ditches and culvert inlets and outlets to achieve positive drainage and a uniform ditch width, depth, and grade. Dispose of waste as shown on the plans.

303.04 Shoulder Reconditioning. Repair soft and unstable areas according to Subsection 204.07. Remove all slide material, vegetation, and other debris from existing shoulders including shoulders of parking areas, turnouts, and other widened areas. Dispose of waste as shown on the plans.

303.05 Roadbed Reconditioning Repair soft and unstable areas according to Subsection 204.07. Remove all organic, deleterious material larger than 6 inches from the top 6 inches of subgrade. Dispose of waste as shown on the plans. Scarify, rip and shape the traveled way and shoulders at locations and to the depth and width designated on the plans. Remove surface irregularities and shape to provide a uniform surface.

Dispose of rock larger than 4 inches brought to the surface during scarification in areas designated on the plans.

For portions of roads not requiring scarification, the roadbed may contain rocks larger than 4 inches provided they do not extend above the finished roadbed surface. Reduce in

place or remove rock extending above the finished roadbed surface. Dispose of removed rock in areas designated on the plans.

Compact using the following method as specified:

- (a) Compaction A. Operate equipment over the full width.
- (b) Compaction B. Operate rollers over the full width of each layer until visual displacement ceases, but not fewer than three complete passes. Use rollers that meet the following requirements:
 - (1) Steel wheeled rollers, other than vibratory, capable of exerting a force of not less than 250 pounds per inch of width of the compression roll or rolls.
 - (2) Vibratory steel wheeled rollers equipped with amplitude and frequency controls with a minimum weight of 6 tons, specifically designed to compact the material on which it is used.
 - (3) Pneumatic-tired rollers with smooth tread tires of equal size that will provide a uniform compacting pressure for the full width of the roller and capable of exerting a ground pressure of at least 80 psi.

303.06 Aggregate Surface Reconditioning. Repair soft and unstable areas to the full depth of the aggregate surface and according to Subsection 204.07. Scarify to the depth of the aggregate surface or to a depth of 8 inches, whichever is less, and remove surface irregularities. Reshape, finish, and compact the entire aggregate surface according to Section 308.

303.07 Roadway Reconditioning. Perform all the applicable work described in Subsections 303.03 through 303.06.

Maintain the existing cross slope or crown unless otherwise shown on the plans. Establish a blading pattern that will retain the surfacing on the roadbed and provide a through mixing of the materials within the completed surface width.

Blade and shape the subgrade for both surfaced and unsurfaced roads when moisture content is suitable for compaction.

303.08 Pulverizing. Scarify the surface to the designated depth and width. Pulverize all material to a size one and one half times the maximum sized aggregate or to 1½ inches, whichever is greater. Mix, spread, compact, and finish the material according to Section 301.

303.09 Acceptance. See Table 303-1 for sampling and testing requirements. Road reconditioning work will be evaluated under Subsections 106.02 and 106.04.

Measurement

303.10 Measure the Section 303 items listed in the Schedule of Items according to Subsection 109.02 and the following as applicable.

Measure ditch reconditioning and shoulder reconditioning by the mile, by the station or foot horizontally along the centerline of the roadway for each side of the roadway.

Measure roadbed reconditioning, aggregate surface reconditioning, roadway reconditioning, and pulverizing by the mile, by the station, or by the square yard.

Payment

303.11 The accepted quantities will be paid at the contract price per unit of measurement for the Section 303 pay items listed in the bid schedule. Payment will be full compensation for the work prescribed in this Section. See Subsection 109.05.

602 - Culverts and Drains

602.03_nat_us_09_06_2005

602.03 General.

Add the following:

Ensure that the final installed alignment of all pipe allows no reverse grades, and does not permit horizontal and vertical alignments to vary from a straight line drawn from center of inlet to center of outlet by more than 2 percent of pipe center length or 1.0 feet, whichever is less.

625 - Turf Establishment

625.03_nat_us_07_02_2007

625.03 General.

Delete this subsection and replace with the following:

Apply turf establishment to prepared ground or any disturbed area between April 15th and October 15th. Apply turf establishment to the areas shown on the plans or worklists within 7 days after completion of ground disturbing activities. Unless otherwise specified in writing by the CO apply turf establishment after each 1000 foot section of road has been constructed to template lines. Seeded areas damaged by construction activities shall be reseeded within 10 days of the damage. Do not seed during windy weather or when the ground is excessively wet, frozen, or snow covered.

Assure that all seed and mulch used in the work conforms to the weed free requirements of Section 713.

625.04 Preparing Seedbed.

Delete entire subsection and replace with the following:

Ensure that the surface soil is in a roughened condition favorable for germination and growth.

625.05 Watering

Delete entire subsection.

625.06 Fertilizing.

Delete entire subsection and replace with the following:

Apply fertilizer having a chemical analysis as listed below by the following methods.

(a) Dry Method. Apply the fertilizer with approved mechanical equipment. Hand operated methods are satisfactory on areas inaccessible to mechanical equipment.

(b) Hydraulic method. Use hydraulic-type equipment capable of providing a uniform application using water as the carrying agent. Add fertilizer to the slurry and mix before adding seed. Add the tracer material when designated by the CO.

Fertilizer. Apply fertilizer at the rate of 450 pounds per acre. Insure that the fertilizer meets the following chemical analysis:

<u>Nutrient</u>	<u>Percent</u>
Nitrogen, N	<u>10</u>
Phosphorus, P ₂ O ₅	<u>20</u>
Potassium, K	<u>20</u>

625.07 Seeding.

Delete the first sentence and add the following.

Apply seed mix by the following methods:

(a) **Dry method.** Delete the third sentence.

Add the following after subsection

(b).**Seed Mix.** Furnish and apply the following kinds and amounts of pure live seed from Ernst Conservation Seeds, 9006 Mercer Pike, Meadville, PA (800) 873-3221 or Fax (814) 336-5191 or www.ernstseed.com Native Right-of Way Woods Seed Mix with Annual Ryegrass-ERNMX-132-1:

<u>Type of Seed</u>	<u>Quantity of Pure Live Seed (Lbs/Acre)</u>
1. 30% Virginia Wild Rye	9
2. 20% Annual Rye Grass	6
3. 15% Shelter Switchgrass	4.5
4. 10% Creeping Red Fescue	3
5. 5% Autumn Bentgrass	3
6. 5% Fox Sedge	3
7. 5% Showy Tick Trefoil	3
8. 5% Nimble Will	3
9. 5% Tioga Deer Tongue	3

Total Seeding Rate 30lb per acre

Determine the pounds of seed to be furnished per acre by dividing the pounds of pure live seed required per acre by the product of the percent purity and percent germination.

625.08 Mulching.

Delete the entire subsection and replace with the following:

Apply Mulch within 24 hours after seeding by the following methods.

(a) **Dry Method.** Apply mulch with a hand spreader or a spreader utilizing forced air at a rate of 4000 pounds per acre. Anchor the mulch with an approved stabilizing emulsion tackifier at a rate of 0 gallons per acre. Do not mark or deface structure, pavements, utilities, or plant growth with tackifier.

(b) **Hydraulic Method.** Apply mulch in a separate application from the seed using hydraulic-type equipment according to Subsection 625.07(b).

Apply wood fiber or grass straw cellulose fiber mulch at a rate of 775 pounds per acre.

Apply bonded fiber matrix hydraulic mulch at a minimum rate of 775 pounds per acre. Apply so no hole in the matrix is greater than 0.04 inches. Apply so that no gaps exist between the matrix and the soil.

Inaccessible areas may be mulched by hand. Apply mulch uniformly over the entire disturbed area.

625.09 Protecting and Caring for Seeded Areas

Delete the first sentence and add the following:

Protect and care for seeded areas until final acceptance.

625.11 Measurement.

Delete the entire Subsection and replace with the following:

Measure the Section 625 items listed in the bid schedule according to Subsection 109.02.

SPS 703 - Aggregate

Add the following: **703.20 Driving Surface Aggregate.** All Driving Surface Aggregate (DSA) is to be derived from natural limestone formations. Stone is defined as rock that has been crushed; rock is defined as consolidated mineral material. For use in this program, both are restricted to that which has been mined or quarried from existing bedrock formations.

All components of the aggregate mix are to be derived from crushed parent rock material that meets program specifications for abrasion resistance, pH and freedom from contaminants. Ninety-eight percent (98%) of the fines passing the #200 sieve must be parent rock material. No clay or silt soil may be added. The amount of particles passing the #200 sieve shall be determined using the washing procedures specified in PTM No. 100.

Size: The required amount and allowed ranges, determined by weight, for various size particles are:

PASSING SIEVE	LOWER%	HIGH%
1 ½ inch	100%	
¾ inch	65%	90%
#4	30%	65%
#16	15%	30%
#200	10%	20%

LA Abrasion: The acceptable limit is measured by weight loss is “less than 40% loss”. Los Angeles Abrasion test, AASHTO T-96 (ASTM C 131) shall be used to determine this property. Existing tests made for and approved by PennDOT will be accepted.

Sulfate Test: Soundness or resistance to freeze/thaw (i.e. sulfate test) is not specified for this application because a gravel road driving surface aggregate is not bound within a concrete or asphalt mix.

pH: Aggregate must be within the range of pH 6 to pH 9 as measured by EPA 9045C.

Optimum Moisture: Material is to be delivered and placed at optimum moisture content as determined for the particular source. The optimum percentage moisture is to be identified by the supplier in the bid purchasing documents. Loads with excessive moisture shall be rejected. Water draining from the tailgate, excess material sticking to the roller drum or the inability to compact the material are field indicators of excess moisture. In addition, if a load is too dry or does not have enough fines it will be rejected. Visual inspection of the load and poorly consolidated material after compactive effort are field indicators of low moisture or poor product gradation.

Transport: Tarps are to be used to cover 100% of the load's exposed surface from the time of loading until immediately before dumping. This requirement includes standing time waiting to dump.

Aggregate producers are required by the program to certify that the aggregate they deliver conforms to the program specifications. To eliminate segregation of material, stockpiling of material at jobsite will not be permitted unless authorized by COR.

The following are "Local" sources for this material:

Hawbaker – Turtlepoint, PA. 814-237-1444 or 814-642-2500

New Enterprise Stone & Lime Co. Tyrone, PA 814-695-4405

Road Preparation Specifications: The road surface to receive the aggregate should have template with crown of 2% or ¼ inch per foot. The receiving surface is to be scarified to permit knitting of the aggregate.

Driving Surface Aggregate Placement: Minimum compacted depth of four inches is to be established for driving surface. Driving Surface Aggregate is to be applied by tailgate spreading unless spreader box is specified. Material when placed shall be compacted as follows: Beginning on the lower or berm side of the crown, begin rolling and work your way to the top of the crown by overlapping the successive longitudinal passes. Do not run the roller lengthwise directly on the crown. Compaction with truck tires is not accepted. Steel wheel rollers other than vibratory shall be capable of exerting a force of not less than 250 pounds per inch of width of the compression roller or rollers. Rollers shall be self propelled with a minimum weight of 6 tons. Contractor must have certification in writing that material placed is Driving Surface Aggregate meeting this specification.

1" Minus Aggregate (DSA Gravel non limestone) Size: The required amount and allowed ranges, determined by weight, for various size particles are:

PASSING SIEVE	LOWER%	HIGH%	
1 ½ inch	100%		
¾ inch	65%	95%	
#4	30%	65%	LA Abrasion < 40%
#16	15%	30%	Sulfate Test – Not Applicable
#200	10%	15%	PH between 6 and 9

Material available at Glenn O. Hawbacker – Pittsfield Pit 814-563-7911

SPS 705 - Rock

Replace 705.02 with the following:

705.02 **Riprap Rock.** Furnish rock sound, free from structural defects and foreign substances such as soil, shale, and organic materials. Use rock conforming to the following requirements:

No shale seams

Hard and angular shaped rock with neither width nor thickness less than one-third its length.

Minimum specific gravity of 2.5 as determined according to AASHTO T 85, bulk saturated, but surface-dry basis.

Each load of rock well-graded, from smallest to the largest size

Class, Size No. Rock Size (inches)	Percent Passing (Square Openings)				
	R-7	R-6	R-5	R-4	R-3
30	100				
24		100			
18	15-50		100		
12	0-15	15-50		100	
9			15-50		
6		0-15		15-50	100
4			0-15		
3				0-15	15-50
2					0-15
Nominal Thickness	36	30	24	18	12